

Technical Service Bulletin 808

MBR & Submerged UF System Design

This technical manual provides comprehensive guidance for engineers and system designers working on Membrane Bioreactor (MBR) & submerged ultrafiltration (UF) Systems. The information contained within addresses fundamental design considerations, operational parameters, and best practices for implementing successful UF & MBR installations in water and wastewater treatment applications.

Key Operating Parameter Definitions

Filtrate flow rate

Filtrate flow rate is the rate of the water that passes through the membrane from the feed side to the filtrate side. It is a function of the pressure, and the quality of the feed water. The filtrate flow rate should be set in according to NANO H₂O's recommended membrane flux.

Filtrate flux

Filtrate flux is the volume of filtered water passing through a unit of membrane surface area in a specified period of time. It is commonly expressed as l/mh (Liters of filtered water/m² of surface area/hour of filtration time), gfd (gallons of filtered water/ft² of surface area/day of filtration time), or m/d (m³ of filtered water/m² of surface area/day of filtration time). Appropriate flux selection is one of the most important design and operating considerations. The filtrate flux should be set according to NANO H₂O's recommendation for your specific application. The flux may be increased or decreased during operation to account for changes in feed water quality, temperature or product water demand.

Transmembrane Pressure

Transmembrane Pressure (TMP) is the pressure difference between the feed and filtrate sides of the membrane. It is commonly measured in units of bar, psi, or kPa. TMP is the driving force for filtration. Most ultrafiltration systems operate at a constant flow rate during filtration. As filtration occurs, solids deposited on the membrane surface will create resistance to filtration causing the TMP to increase. Proper design filtrate flux is necessary to control the rate of TMP increase. Physical and chemical cleaning are required to remove accumulated fouling and reduce TMP. The maximum allowable TMP is 0.05 MPa (7.2 psi).

Normalized permeability

Normalized permeability, or specific flux, is defined as filtrate flux per applied transmembrane pressure (differential pressure) corrected to a specified temperature, typically 20 or 25 degrees Celsius. It is commonly measured in units of l/mh/bar or gfd/psi @20°C. Normalized permeability is one of the most important parameters used to measure the performance of the membrane system. In a properly designed and operated UF system, the normalized permeability will decrease slowly between cleanings and will return to previous levels after cleaning such that it remains essentially constant over long-term operation.

Filtration cycle duration

The filtration cycle duration is dependent on the quality of the feed water. An appropriate design value should be selected per NANO H₂O's recommendation. The actual time should be set by testing at site and adjusted according to the changes of the feed water quality during the operation. Typical filtration cycle duration is 20-60 minutes for submerged UF and 7-12 minutes for MBR applications.

Technical Service Bulletin 808

MBR & Submerged UF System Design

Membrane Tank Sludge Limiting Conditions

Table 1: Allowable Membrane Tank Sludge Quality

Parameter	Allowed Range	Comments
pH in membrane tank	1 – 10 (TIPS)	1–14 allowed during cleaning (TIPS)
Particle Size ¹	≤ 2.0 mm	≤ 2 mm by automatic screening Perforated plate or punched hole
Mixed Liquor temperature °C (°F)	5 – 45 (41 – 113)	
MLSS in membrane tank, mg/L MBR only	5,000 – 12,000	Normal range 6,000 – 8,000
Oil	<2 mg/L (TIPS)	To prevent membrane fouling
Dissolved Oxygen, mg/L	> 2	For MBR only
Total hardness (mg/L as CaCO ₃)	Non-scaling	Dependent on pH and scaling
Soluble BOD ₅ Concentration (mg/L)	< 3	
NH ₃ -N concentration in mixed liquor entering	≤ 1.0	
Colloidal TOC (cTOC) concentration in mixed liquor entering membrane tanks (mg/L)	≤ 10	
Soluble alkalinity of mixed liquor entering membrane tanks (mg/L as CaCO ₃)	50 – 150	

¹ Primarily concerned with the entry of sharp objects into the treatment system such as branches, plastic pieces, sand etc., and fibrous material, such as hair.

* This is not an extensive list and does not constitute the only conditions for a valid warranty claim. Refer to your project specific warranty document for all conditions that apply to your warranty.

Technical Service Bulletin 808

MBR & Submerged UF System Design

Design Fundamentals

Membrane Selection

The selection of appropriate membrane materials and configurations forms the foundation of successful UF system design. Polymeric membranes, typically fabricated from PVDF (polyvinylidene fluoride), offer excellent chemical resistance and mechanical strength. The nominal pore size typically ranges from 0.01 to 0.04 micrometers, enabling effective removal of suspended solids, bacteria, and other particulates while allowing dissolved constituents to pass through.

Hydraulic Design Parameters

The hydraulic design of submerged UF/MBR systems must account for several critical parameters. The specific flux, typically expressed in liters per square meter per hour (LMH), determines the membrane area required. Design flux rates for submerged UF generally range from 40-70 LMH for drinking water applications and 30-50 LMH for wastewater applications, depending on feed water quality and operational conditions. For MBR, the typical flux rate is 10-25 LMH depending on the application.

Transmembrane pressure (TMP) must be carefully controlled, typically 0.5 bar, to maintain stable operation while preventing membrane damage. The relationship between flux and TMP should be evaluated during the design phase to ensure optimal performance throughout the system's lifecycle.

Module Configuration

Membrane modules must be arranged to facilitate effective air scouring and maintain uniform flow distribution. Typical configurations include vertical arrays with modules resting on the tank bottom. Adequate spacing between modules (typically 55-85mm) ensures proper air distribution and prevents localized fouling.

Air Scouring System Design

The air scouring system represents a crucial component in submerged UF/MBR design. Coarse bubble aeration provides mechanical cleaning action to control fouling and maintain membrane permeability. Air flow rates are provided in the NANO H2O projection software output.

The air distribution system should incorporate the following design modules:

Header pipes must be sized to maintain uniform air distribution across all modules. Manifold design should account for pressure losses and ensure balanced flow.

Chemical Cleaning Systems

Effective chemical cleaning capabilities must be integrated into the system design. Both maintenance cleaning (MC) and recovery cleaning (RC) should be incorporated. The chemical cleaning system should include:

- Storage tanks sized for cleaning solution volumes based on module requirements
- Chemical metering pumps with appropriate materials of construction
- Distribution piping with proper chemical resistance
- Neutralization capabilities for spent cleaning solutions

Technical Service Bulletin 808

MBR & Submerged UF System Design

Typical cleaning chemicals include sodium hypochlorite for organic fouling and citric acid for inorganic fouling. The appropriate cleaning chemicals, dosage rates and MC/RC frequencies are provided in the NANO H₂O design projection and are typically fine-tuned during startup and operation.

Instrumentation and Control

Robust instrumentation and control systems are essential for monitoring and optimizing UF system performance. Key parameters requiring continuous monitoring include:

- Flow rates (feed, permeate, and air scour)
- Transmembrane pressure
- Turbidity (feed and permeate)
- Temperature
- pH
- Pressure at various points in the system
- DO & MLSS for MBR applications only

The control system should automate critical processes including filtration cycles, backwashing sequences, and chemical cleaning operations. Integration with SCADA systems enables remote monitoring and data collection for performance optimization.

Pretreatment Requirements

Proper pretreatment design extends membrane life and optimizes system performance. Essential pretreatment steps may include:

- Screening to remove large particles and debris (typically 100-500 microns)
- Grit removal for applications with high suspended solids
- Chlorination for biological fouling control
- Coagulation/flocculation for enhanced particle removal

The pretreatment system should be designed based on detailed feed water analysis and anticipated variations in water quality.

Operational Considerations

Filtration Cycle Design

Filtration cycles must be optimized to balance productivity with membrane fouling control. Typical cycle times will be provided in the NANO H₂O design output and may be optimized based on operational experience and data. The specific duration of cycle times may also be determined based on pilot testing.

Technical Service Bulletin 808

MBR & Submerged UF System Design

Energy Efficiency

Energy consumption represents a significant operational cost for Submerged UF/MBR systems. Design considerations for energy efficiency include:

- Selection of energy-efficient pumps and blowers
- Optimization of air scour rates
- Implementation of energy recovery devices where applicable
- Use of variable frequency drives for equipment

Safety Considerations


System design must incorporate appropriate safety measures including:

- Chemical containment and handling systems
- Emergency shower and eyewash stations
- Proper ventilation for chemical storage areas
- Access platforms and railings for maintenance
- Lock-out/tag-out capabilities for all equipment

**The following Simplified PFD refers to QuantumFlux S series modules
For MBR Application**

The use of this product in and of itself does not necessarily guarantee the removal of cysts and pathogens from water. Effective cyst and pathogen reduction is dependent on the complete system design and on the operation and maintenance of the system. No freedom from any patent owned NanoH2O Co., Ltd., or others is to be inferred. Because use conditions and applicable laws may differ from one location to another and may change with time. Customer is responsible for determining whether products and the information in this document are appropriate for

Customer's use and for ensuring that Customer's workplace and disposal practices are in compliance with applicable laws and other government enactments. NanoH2O assumes no obligation or liability for the information in this document. NO WARRANTIES ARE GIVEN; ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY EXCLUDED. All trademarks stated herein are properties of their respective companies. © NanoH2O Co., Ltd.

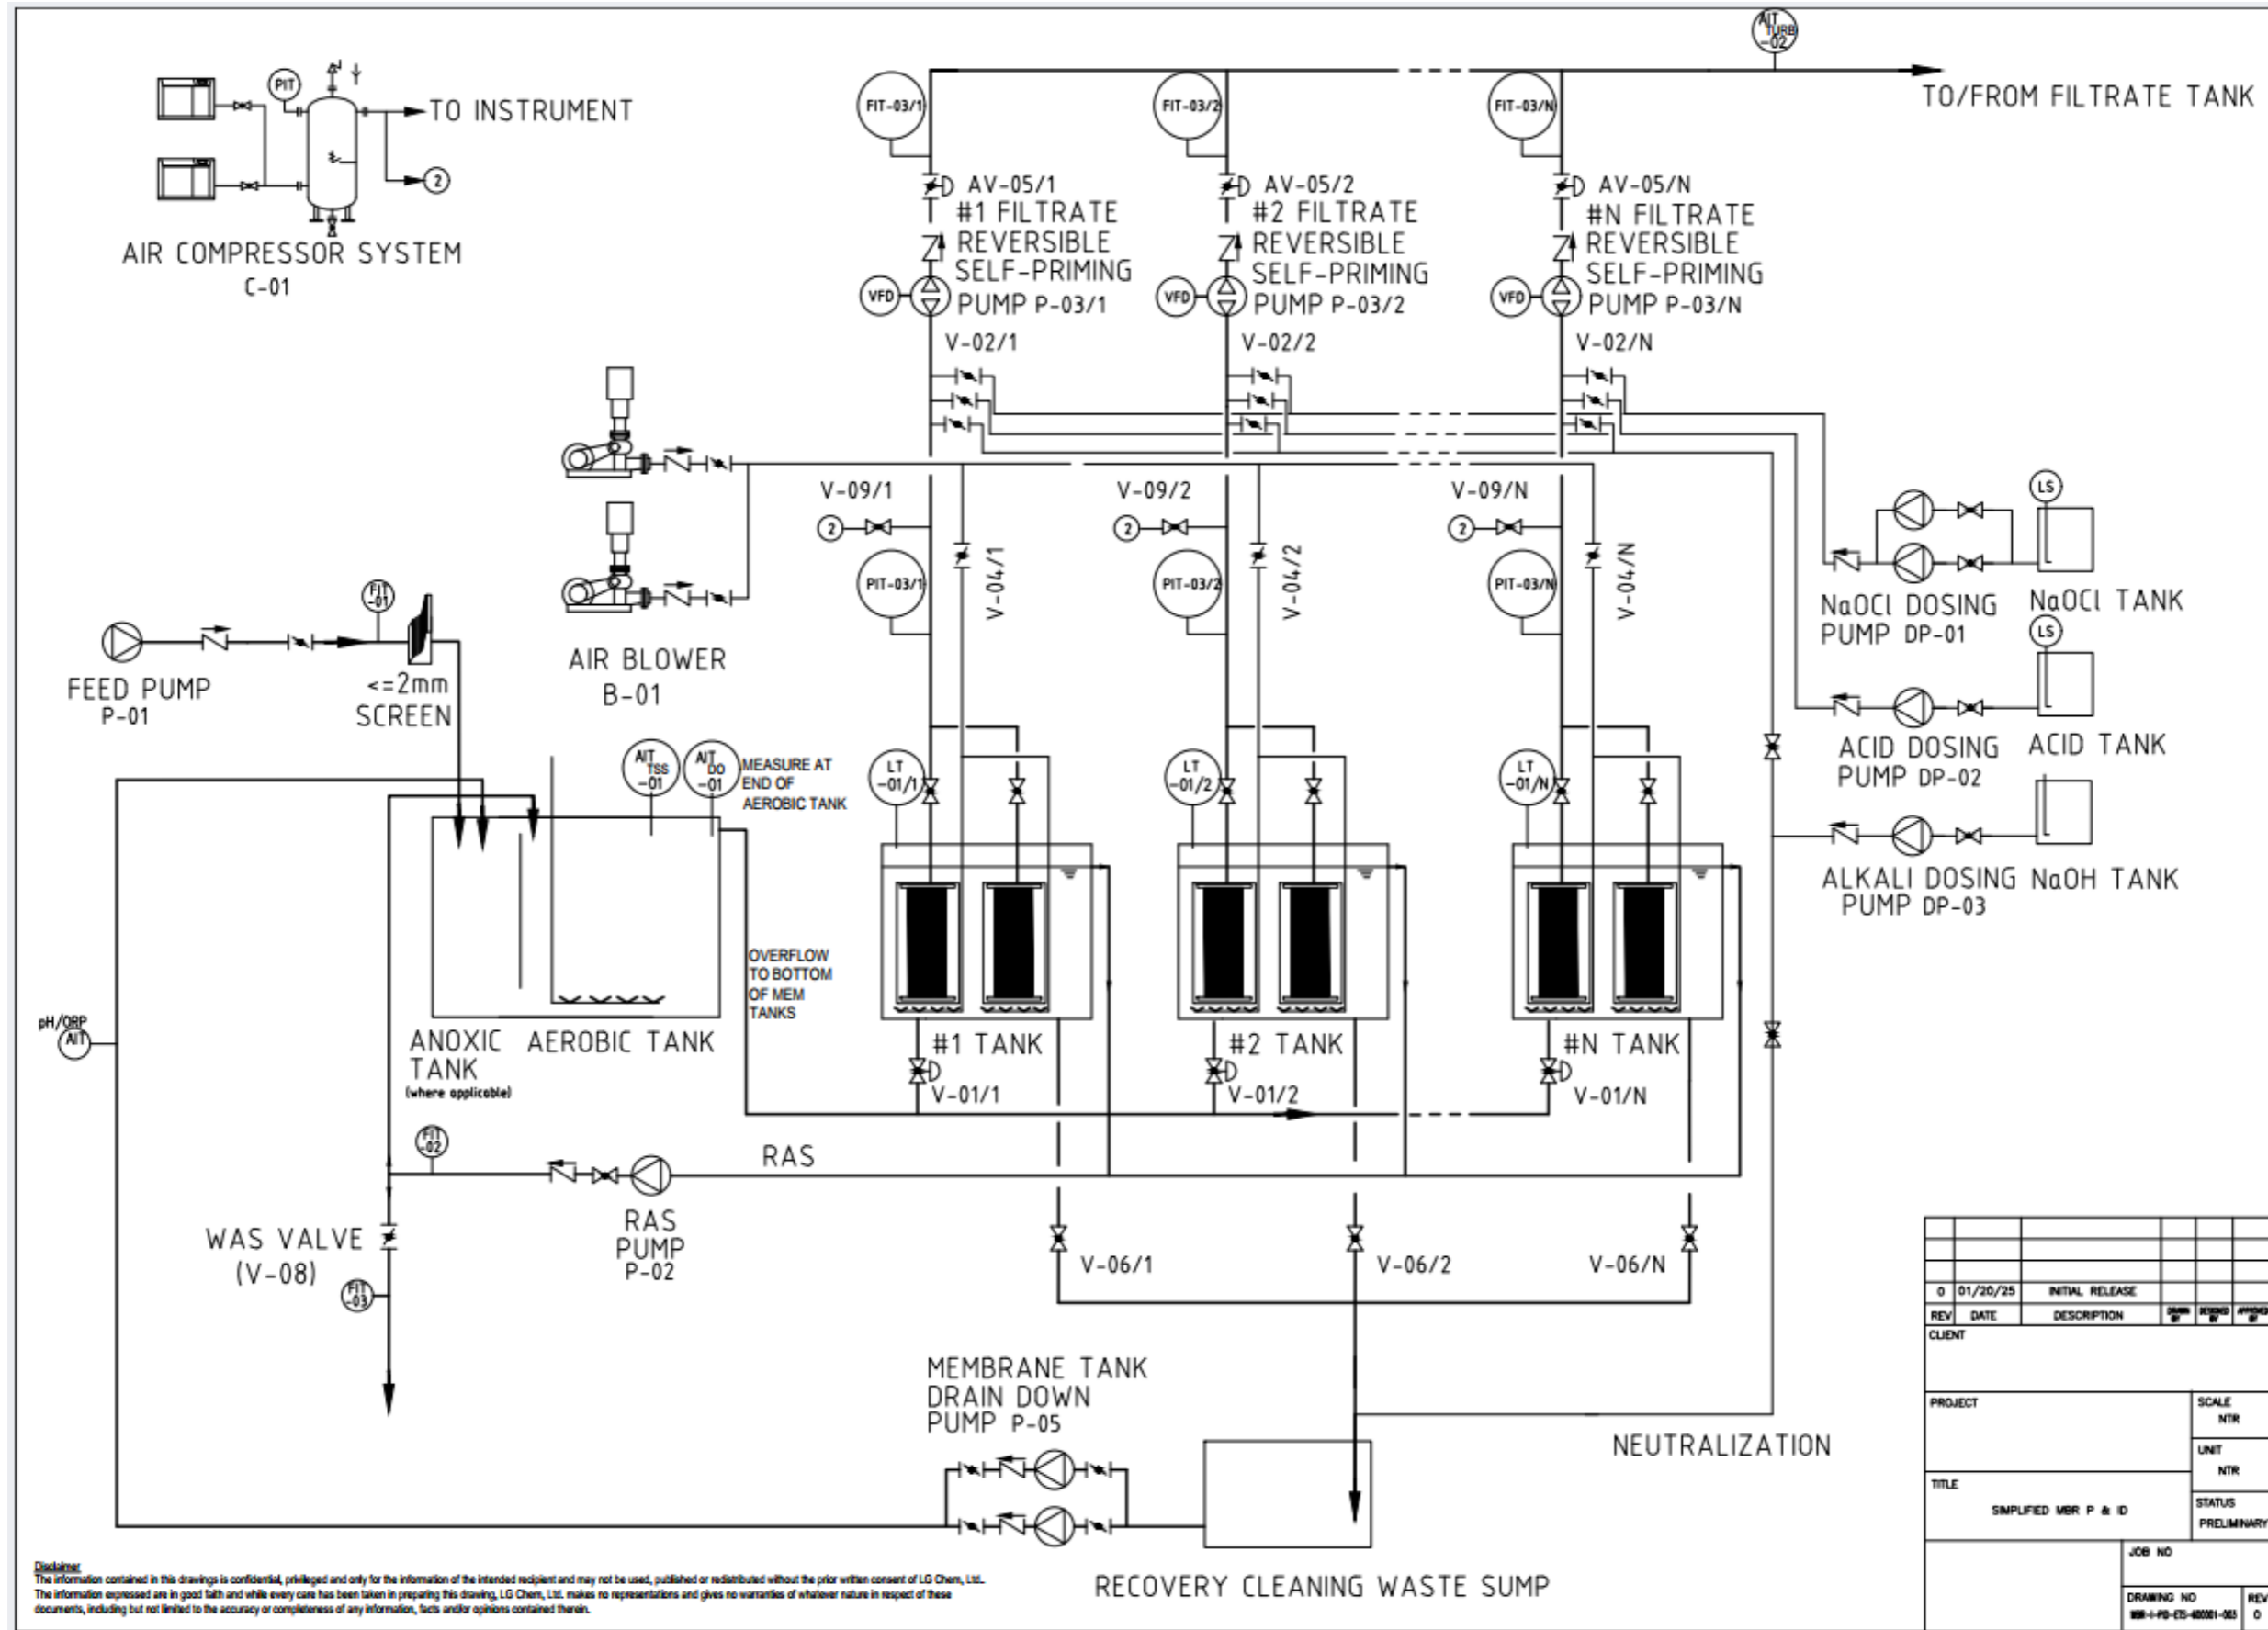



















0	01/20/25	INITIAL RELEASE			
REV	DATE	DESCRIPTION	BY	CHKD	APPD
CLIENT					
PROJECT			SCALE		
			NTR		
TITLE			UNIT		
SIMPLIFIED MBR P & ID			NTR		
			STATUS		
			PRELIMINARY		
JOB NO					
DRAWING NO			REV		
MB-I-PG-ES-40001-05			0		

**The following P&I Diagrams refer to QuantumFlux S Series modules
For MBR Applications**


The use of this product in and of itself does not necessarily guarantee the removal of cysts and pathogens from water. Effective cyst and pathogen reduction is dependent on the complete system design and on the operation and maintenance of the system. No freedom from any patent owned NanoH2O Co., Ltd., or others is to be inferred. Because use conditions and applicable laws may differ from one location to another and may change with time. Customer is responsible for determining whether products and the information in this document are appropriate for


Customer's use and for ensuring that Customer's workplace and disposal practices are in compliance with applicable laws and other government enactments. NanoH2O assumes no obligation or liability for the information in this document. NO WARRANTIES ARE GIVEN; ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY EXCLUDED. All trademarks stated herein are properties of their respective companies. © NanoH2O Co., Ltd.


LEGEND			
<p><u>ABBREVIATIONS</u></p> <p>P = PRESSURE F = FLOW L = LOW LL = LOW LOW H = HIGH HH = HIGH HIGH I = INDICATOR T = TRANSMITTER TURB = TURBIDITY</p>	<p><u>EQUIPMENT</u></p> <p> PUMP</p> <p> CENTRIFUGAL PUMP</p> <p> VARIABLE FREQUENCY DRIVE</p> <p> FINE SCREEN (DRUM TYPE)</p> <p> MIXER</p> <p> STATIC MIXER</p> <p> COMPRESSOR</p> <p> COMPRESSED AIR TANK</p> <p> BLOWER</p>	<p><u>VALVES</u></p> <p> BALL VALVE</p> <p> CHECK VALVE</p> <p> AUTOMATIC VALVE</p> <p> FLOW CONTROL VALVE</p> <p> BUTTERFLY VALVE</p> <p> BALL VALVE</p>	<p><u>ALARMS</u></p> <p>SETTING </p> <p><u>INSTRUMENTATION</u></p> <p>TYPE - TRAIN # / INSTRUMENT #</p> <p></p> <p>EXAMPLE:</p> <p> ULTRASONIC LEVEL TRANSMITTER - TRAIN #2 / LT #1</p>


Disclaimer:
 The information contained in this drawing is confidential, privileged and only for the information of the intended recipient and may not be used, published or redistributed without the prior written consent of LG Chem, Ltd.
 The information expressed here in good faith and while every care has been taken in preparing this drawing, LG Chem, Ltd. makes no representations and gives no warranties of whatever nature in respect of these documents, including but not limited to the accuracy or completeness of any information, facts and/or opinions contained therein.


0	01/20/25	INITIAL RELEASE			
REV	DATE	DESCRIPTION	APP	CHK	APP
CLIENT					
PROJECT			SCALE		
TYPICAL MBR P & ID			NTR		
TITLE			UNIT		
LEGEND			NTR		
			STATUS		
			PRELIMINARY		
			JOB NO		
			DRAWING NO		
			MR-1-P2-ES-4000-01		
			REV		
			0		


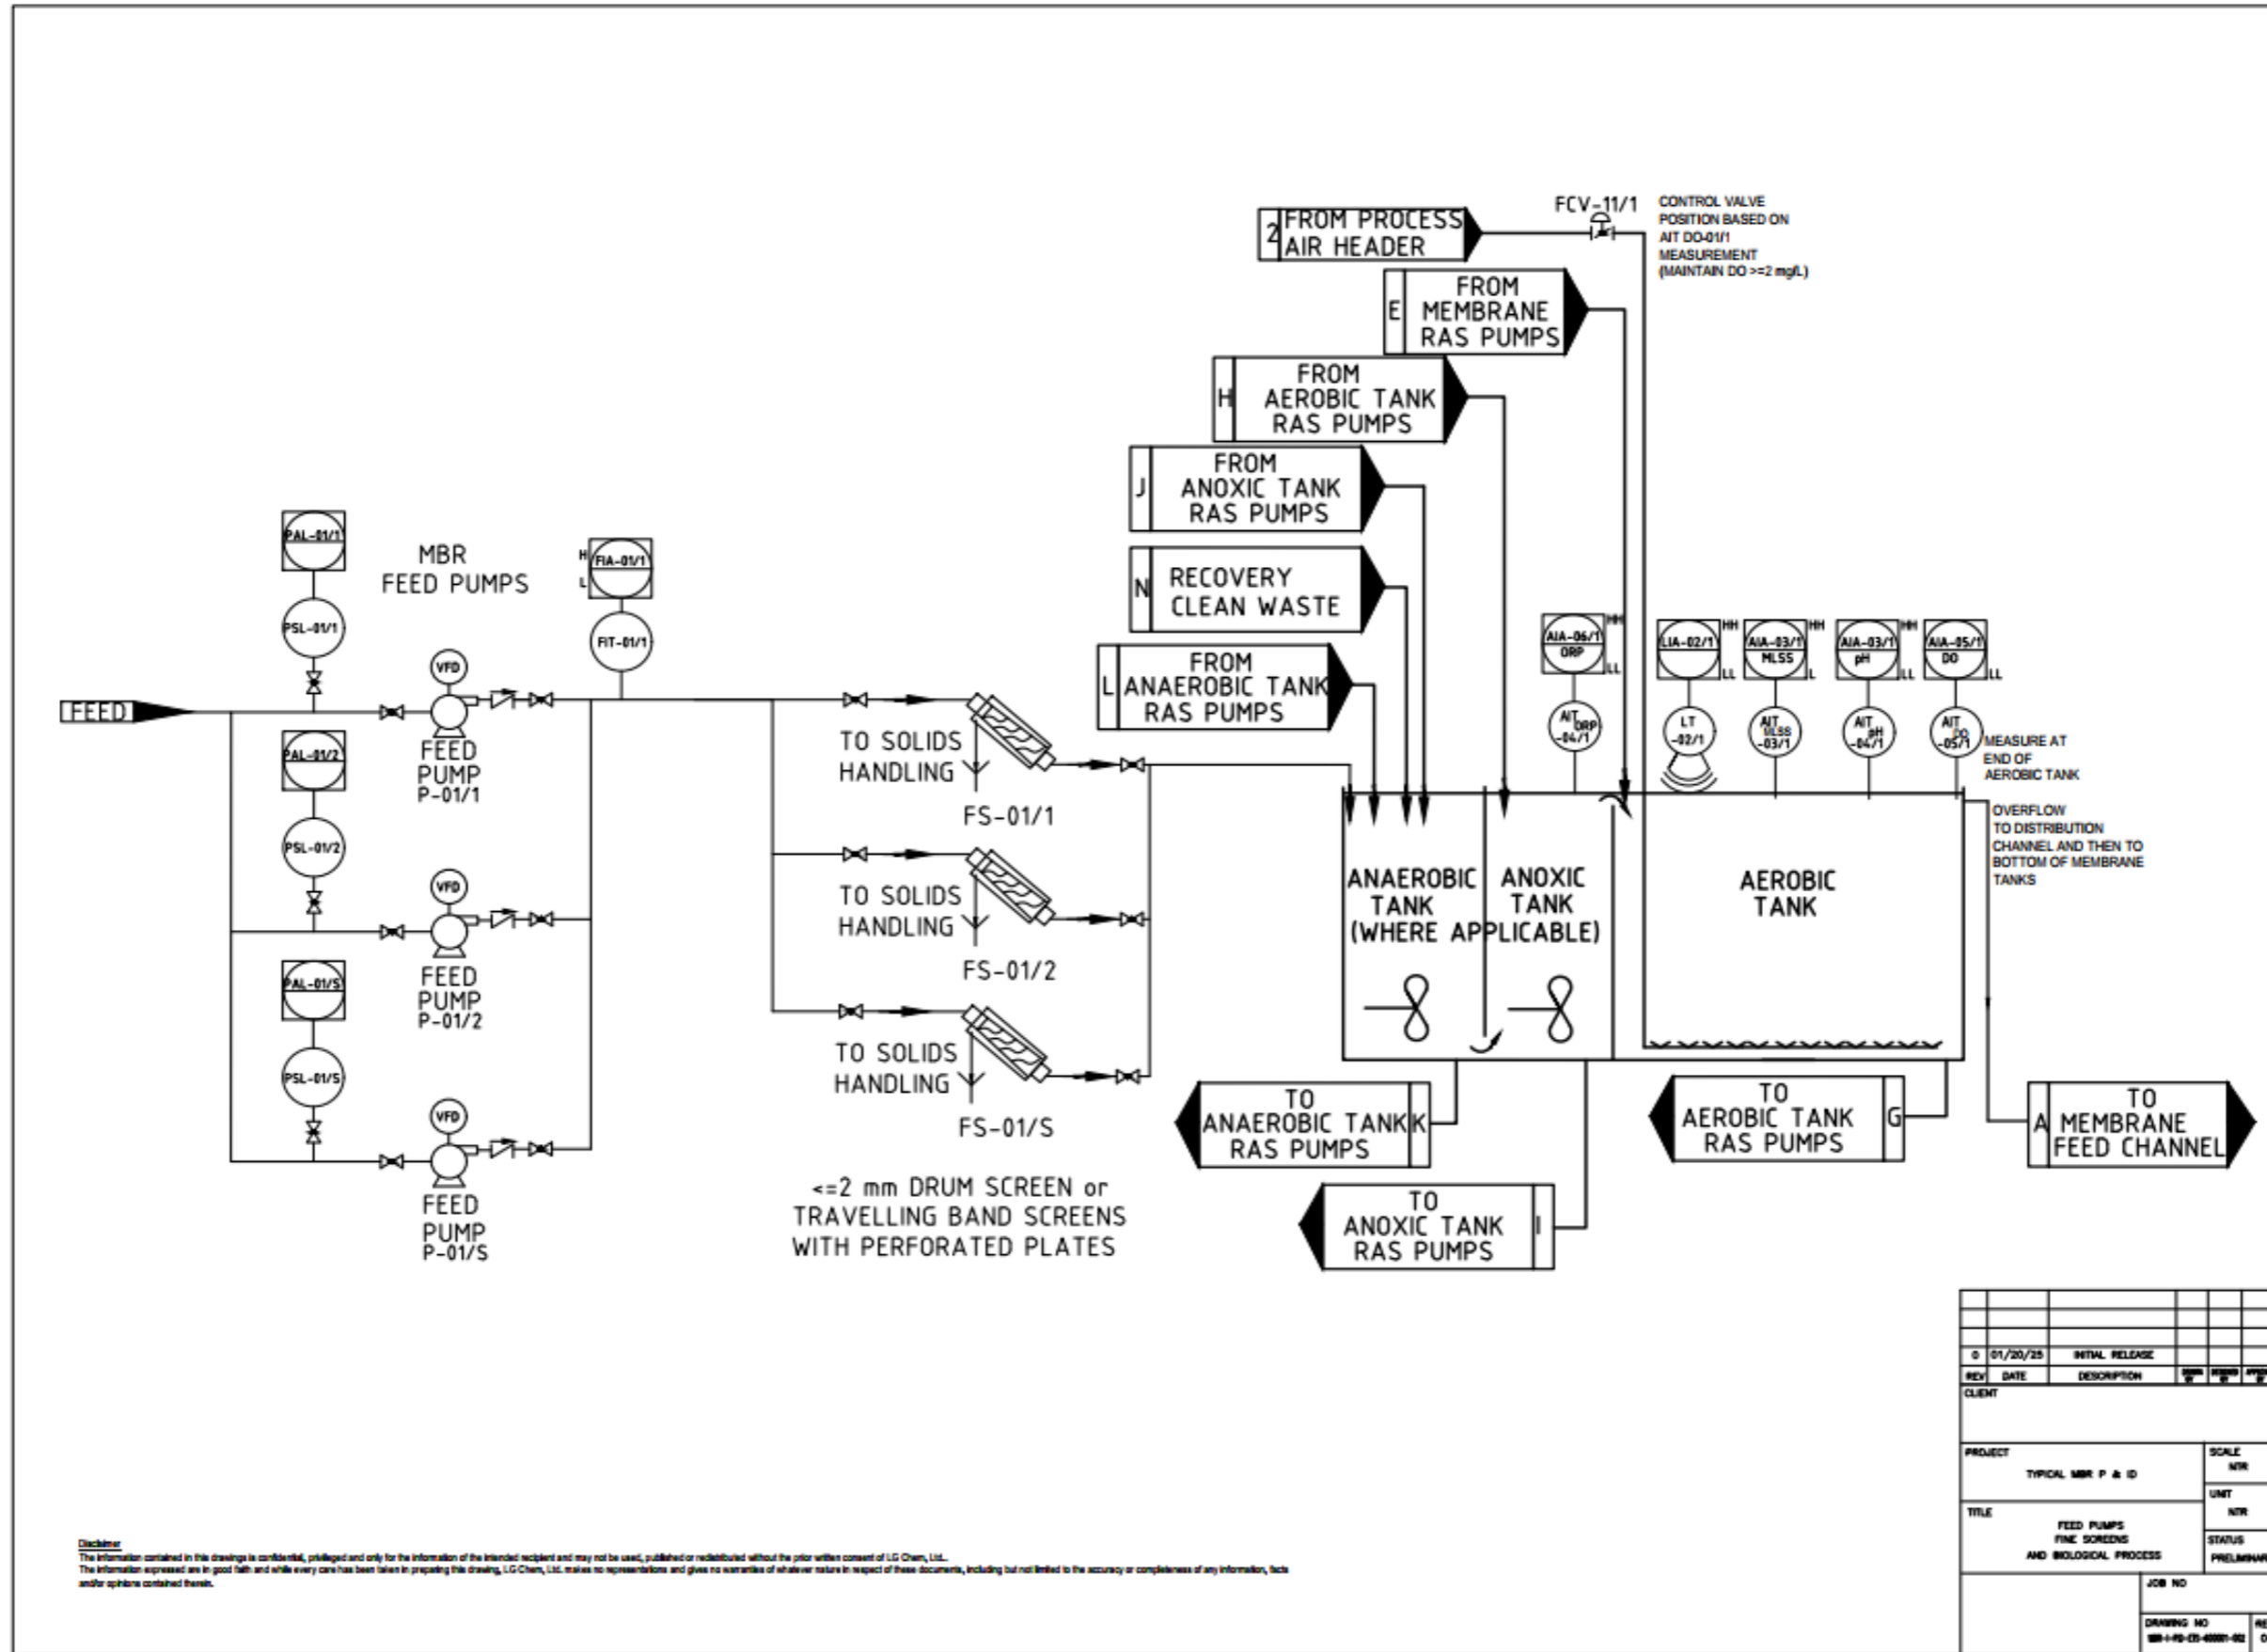


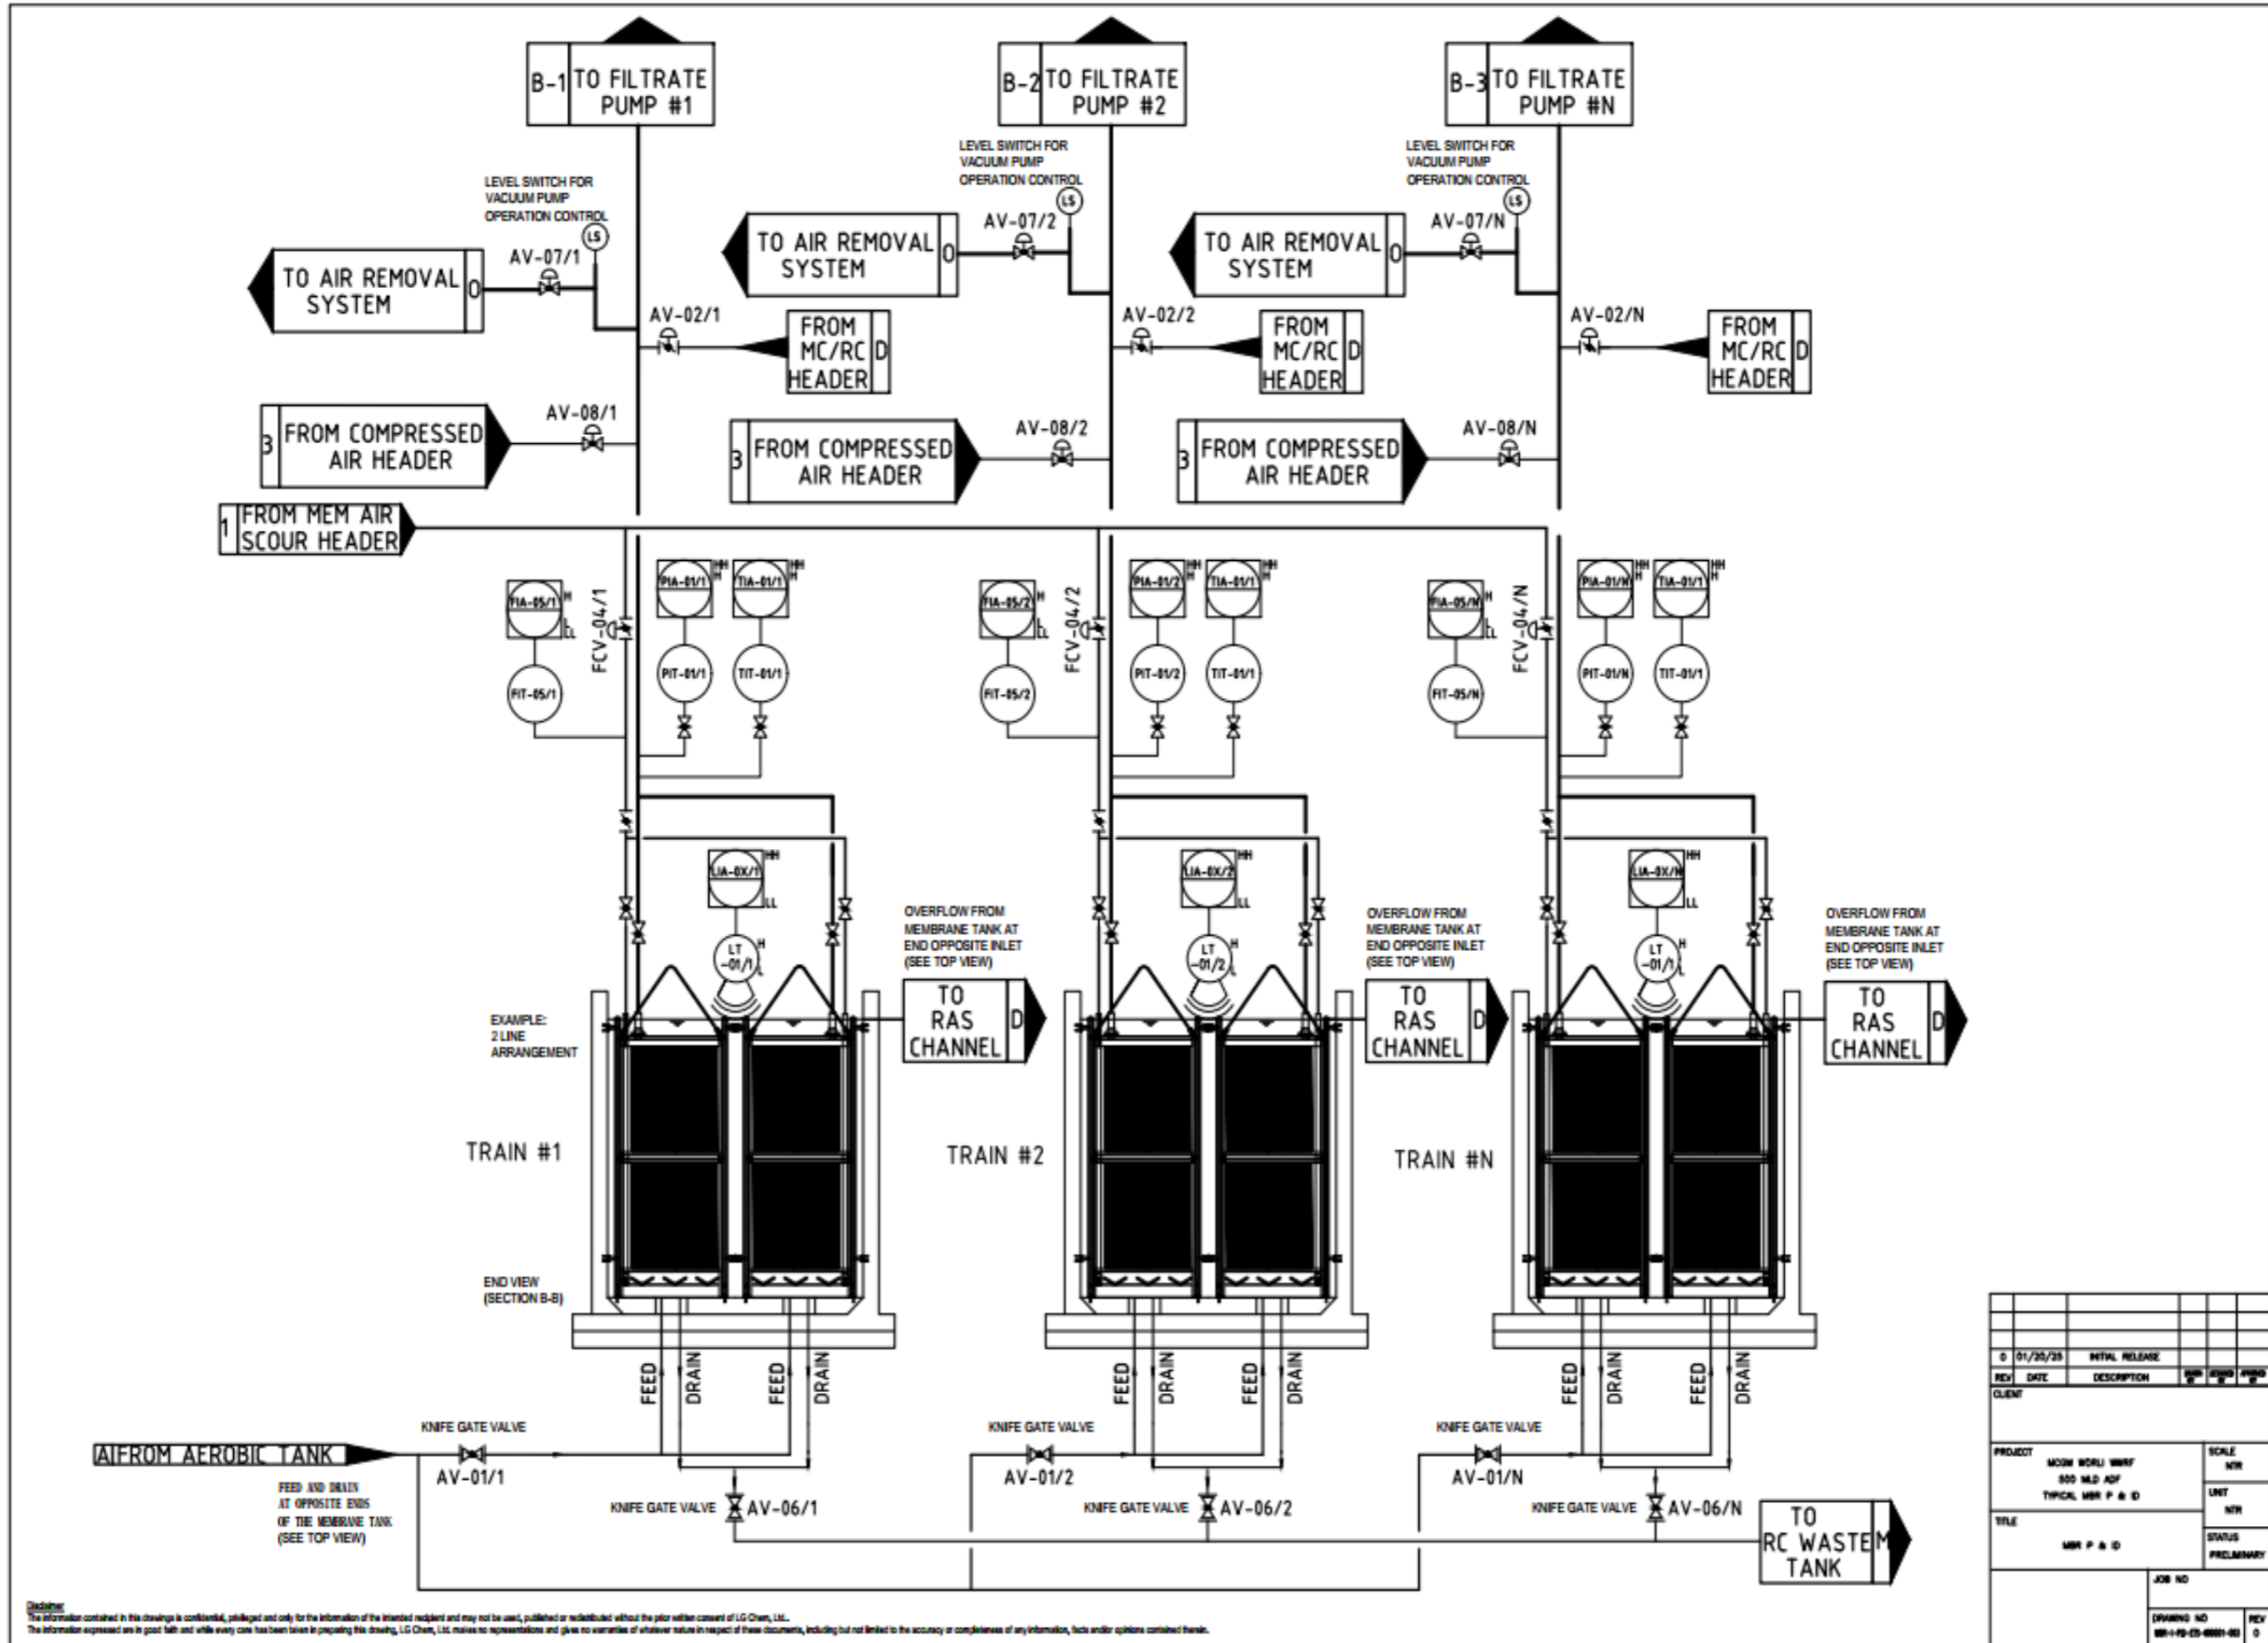

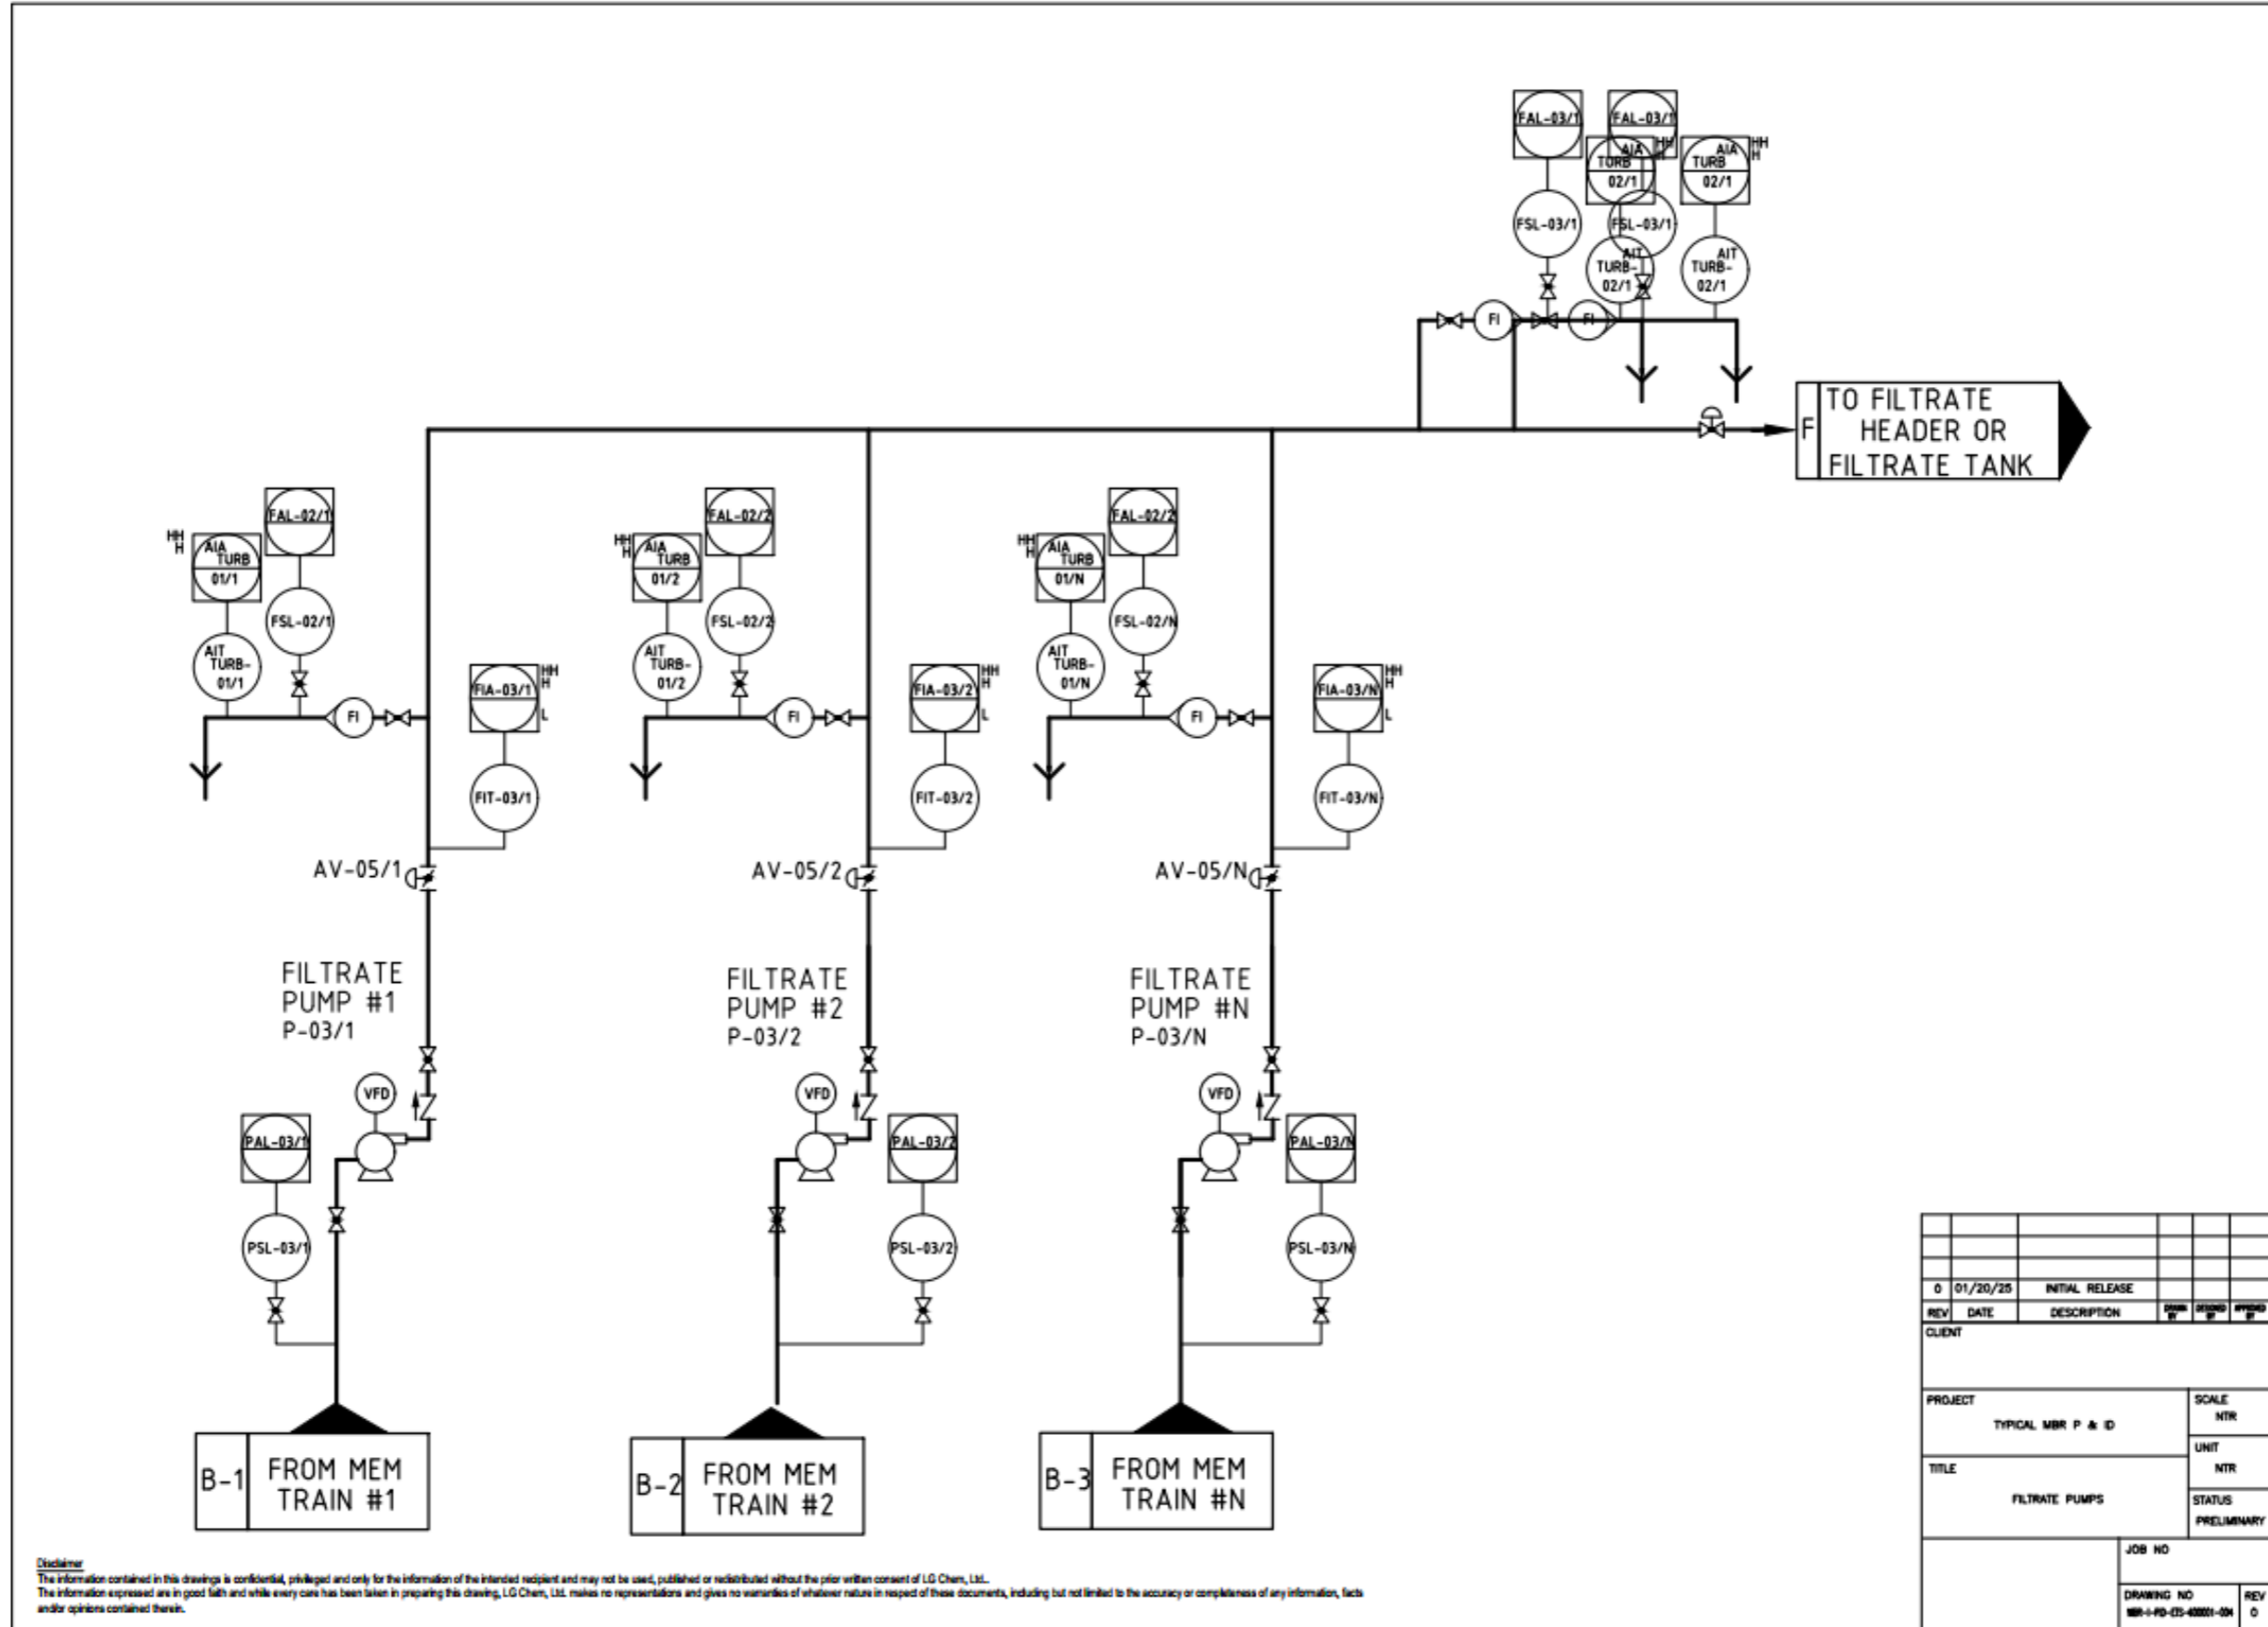

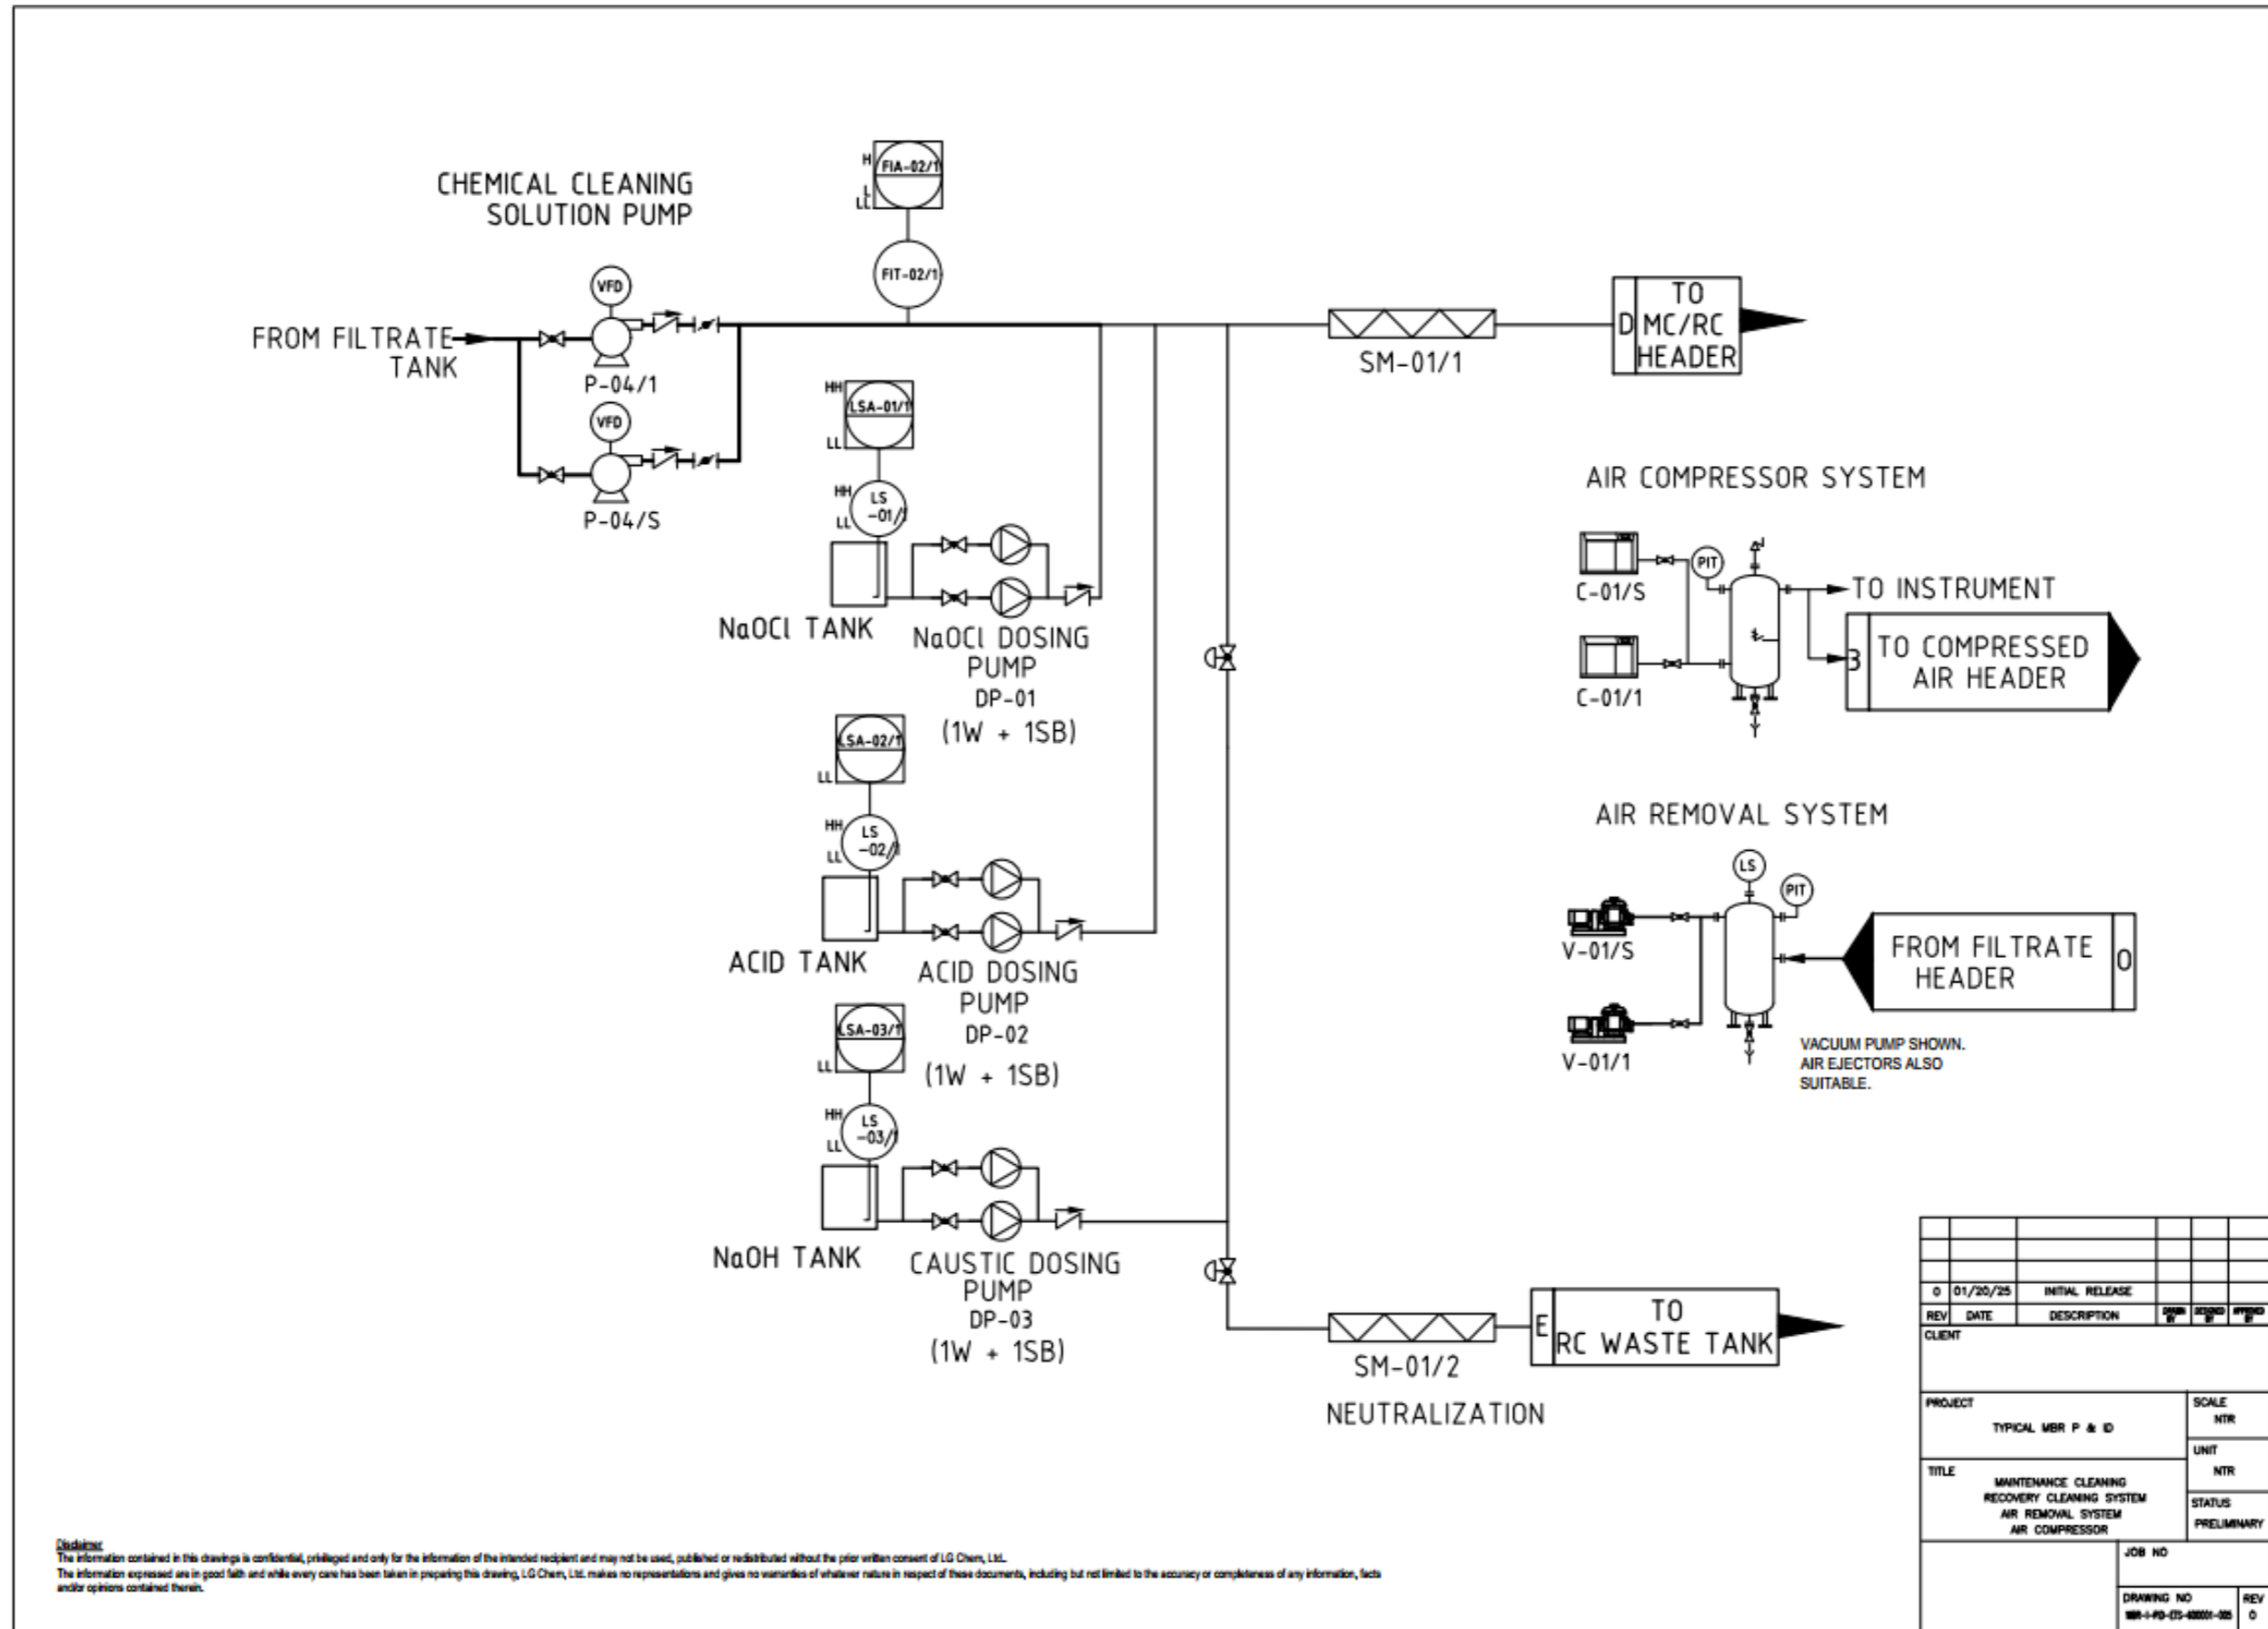


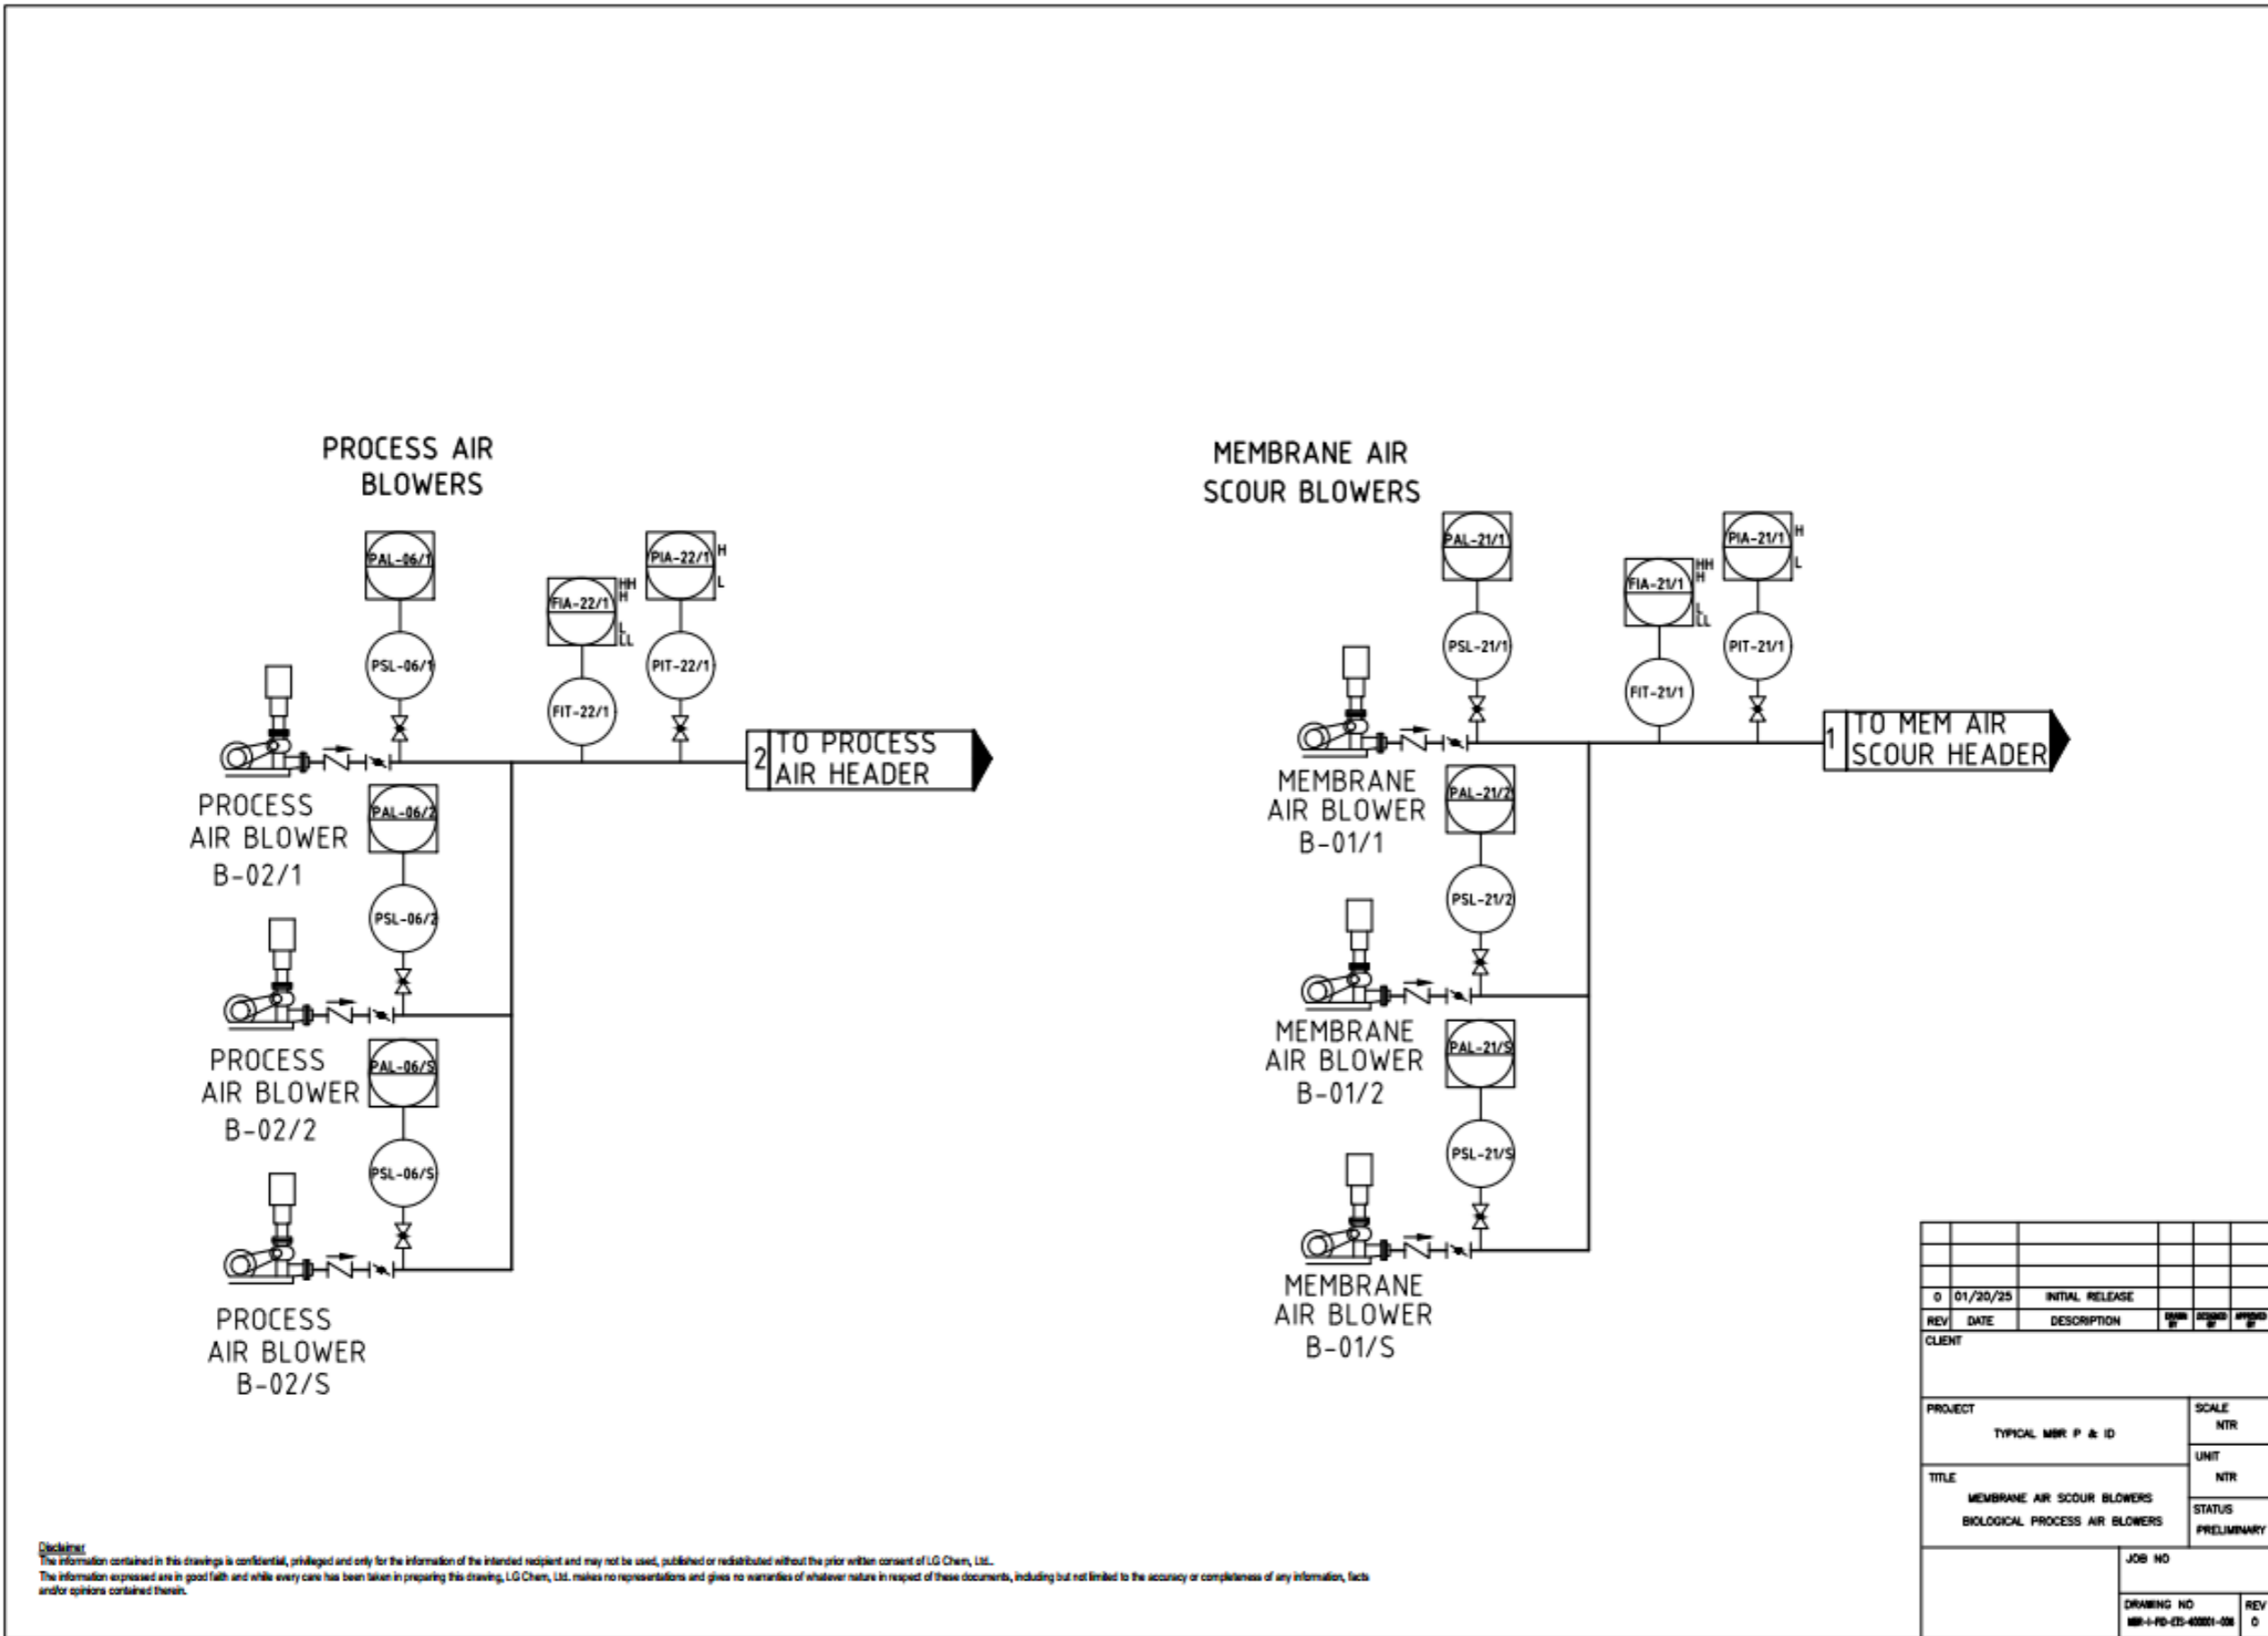

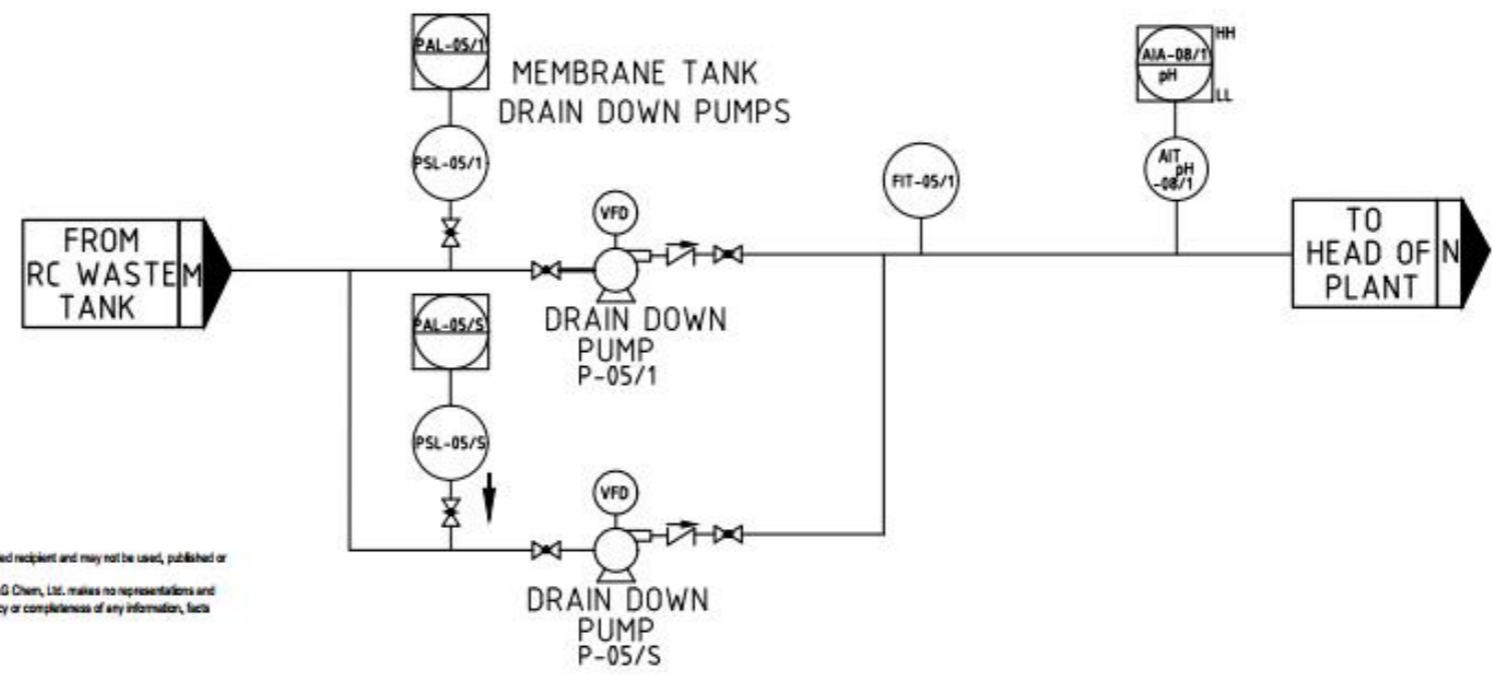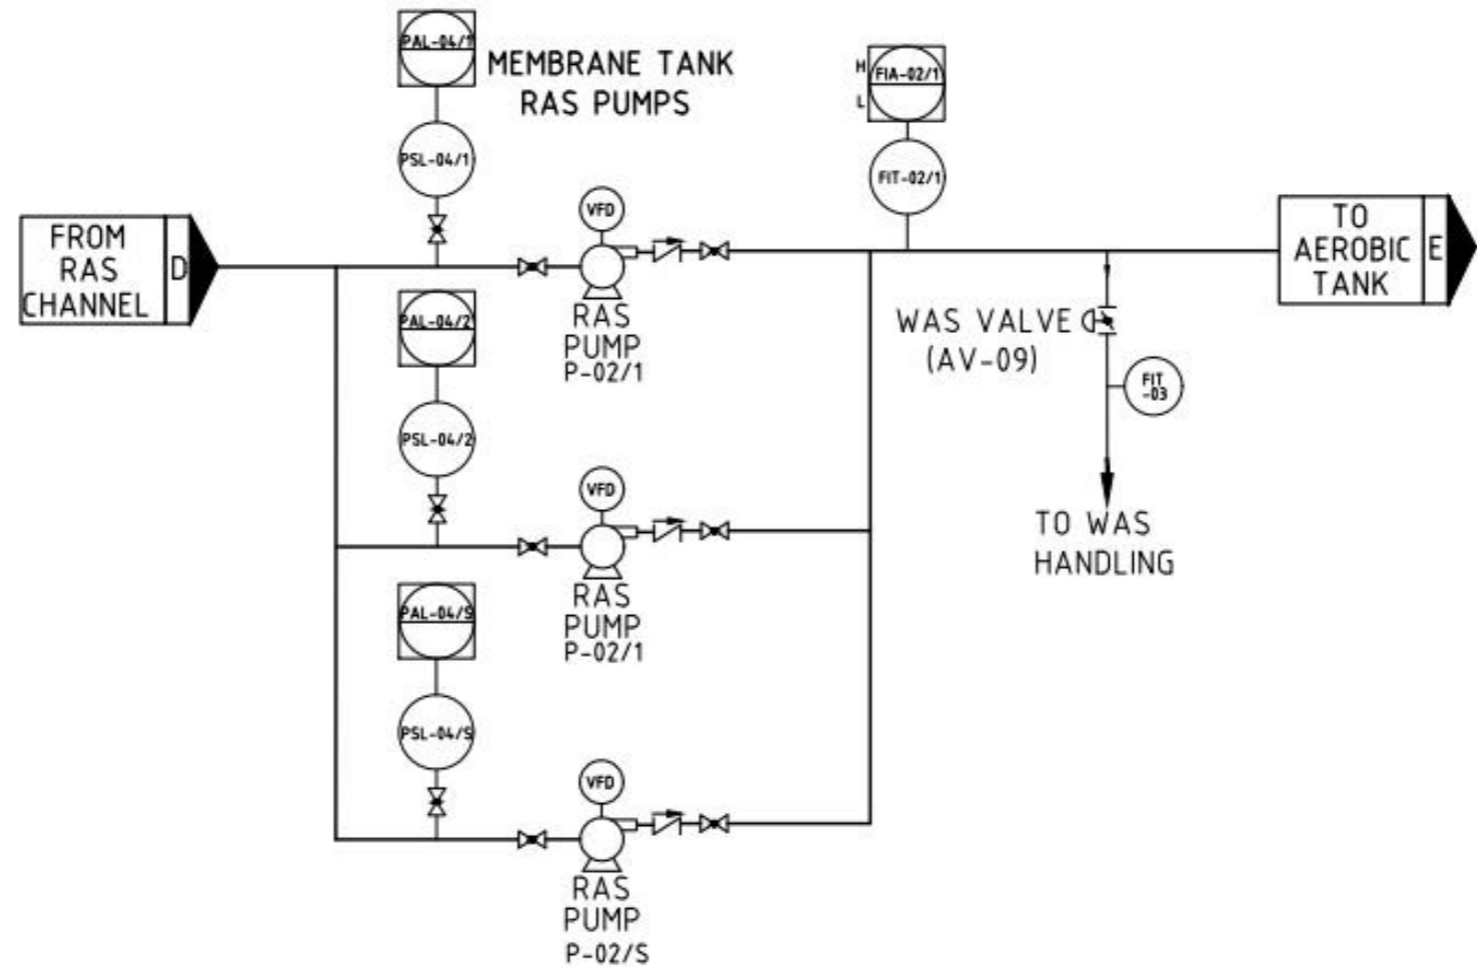

Disclaimer
 The information contained in this drawing is confidential, privileged and only for the information of the intended recipient and may not be used, published or redistributed without the prior written consent of LG Chem, Ltd.
 The information expressed are in good faith and while every care has been taken in preparing this drawing, LG Chem, Ltd. makes no representations and gives no warranties of whatever nature in respect of these documents, including but not limited to the accuracy or completeness of any information, facts and/or opinions contained therein.

0	01/20/25	INITIAL RELEASE			
REV	DATE	DESCRIPTION			
CLIENT					
PROJECT			SCALE		
TYPICAL MBR P & ID			NTR		
TITLE			UNIT		
MEMBRANE TANK RAS PUMPS			NTR		
MEMBRANE TANK DRAIN DOWN PUMPS			STATUS		
			PRELIMINARY		
JOB NO					
DRAWING NO				REV	
MB-I-PE-ES-0001-07				0	

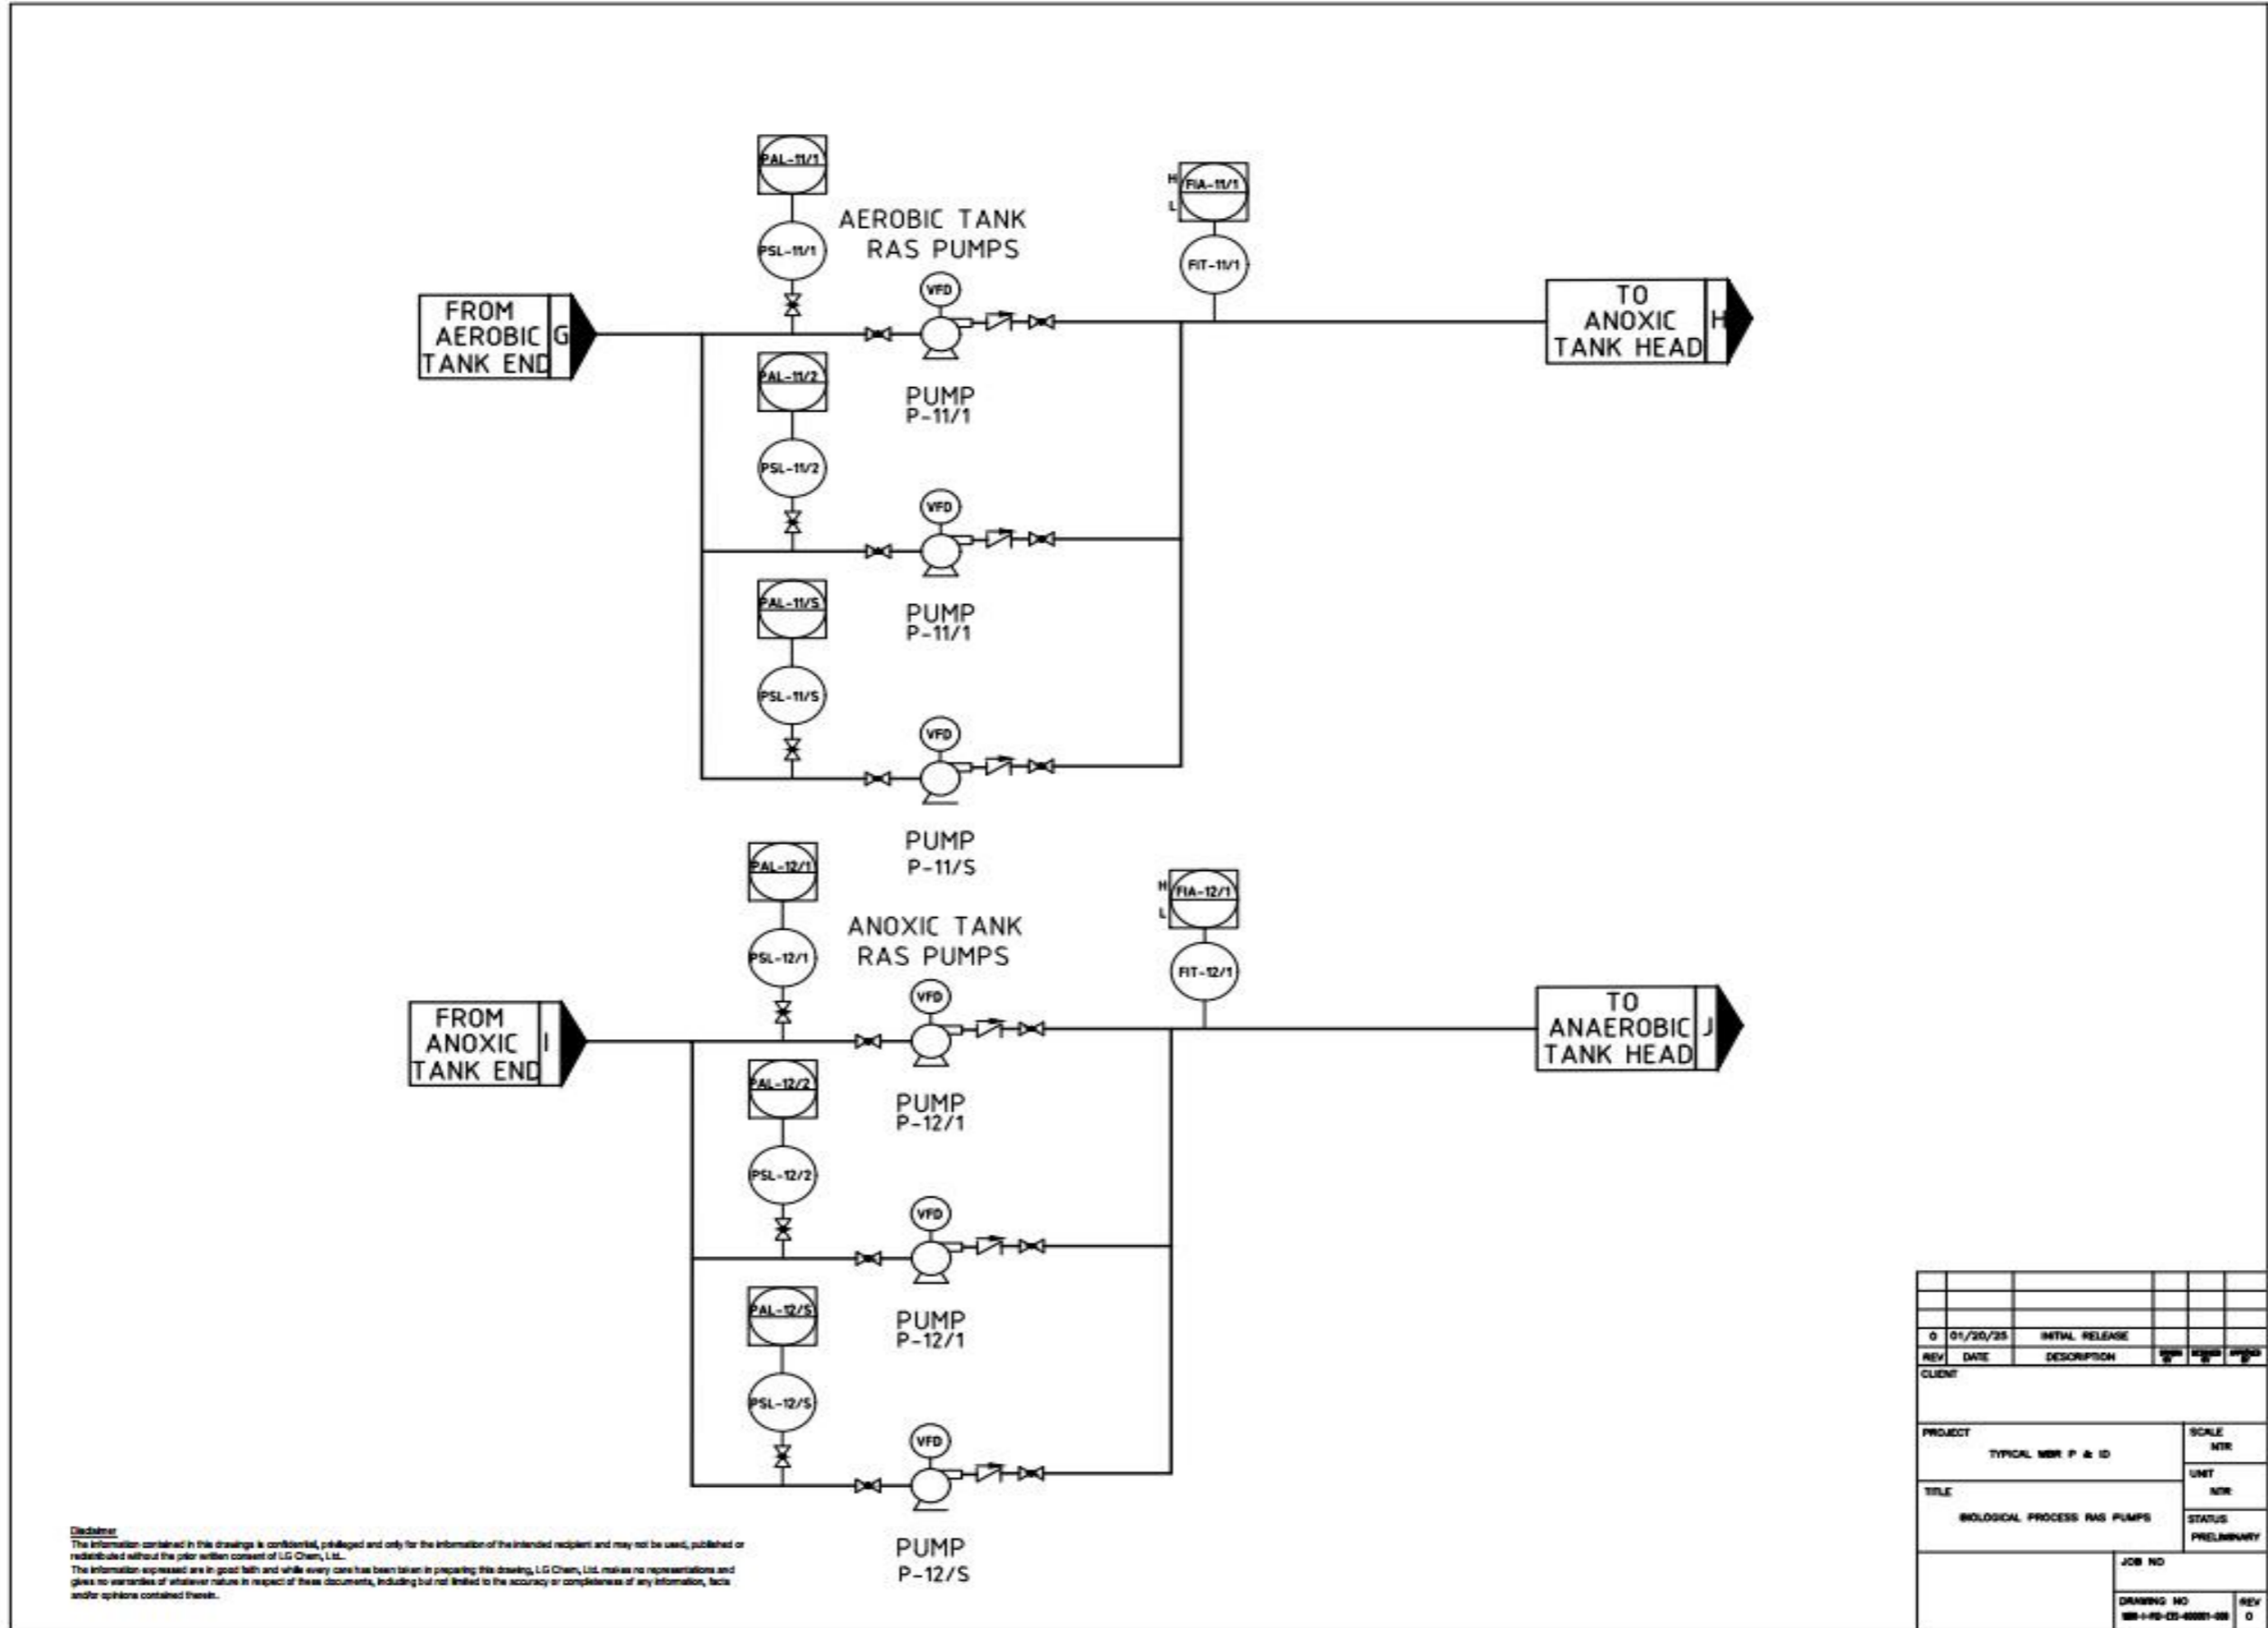

Disclaimer
 The information contained in this drawing is confidential, privileged and only for the information of the intended recipient and may not be used, published or redistributed without the prior written consent of LG Chem, Ltd.
 The information expressed are in good faith and while every care has been taken in preparing this drawing, LG Chem, Ltd. makes no representations and gives no warranties of whatever nature in respect of these documents, including but not limited to the accuracy or completeness of any information, facts and/or opinions contained therein.

0	01/20/25	INITIAL RELEASE			
REV	DATE	DESCRIPTION			
CLIENT					
PROJECT			SCALE		
TYPICAL MBR P & ID			MTR		
TITLE			UNIT		
BIOLOGICAL PROCESS RAS PUMPS			MTR		
			STATUS		
			PRELIMINARY		
			JOB NO		
			DRAWING NO		REV
			MB-110-ES-6001-00		0

