

Reverse Osmosis Membrane

Technical Applications Bulletin 104


Fouling Studies on NanoH2O RO Membranes

NanoH2O has developed fouling-resistant membranes as part of its NanoH2O™ line of brackish water RO (BWRO) membranes. A study was conducted to verify the anti-fouling properties of NanoH2O's membranes against organic and inorganic foulants.

NanoH2O's models BW R and BW AFR were tested under normal/standard operating conditions alongside two competitor's membranes. The feed water consisted of 2,000 ppm of NaCl and 100 ppm of NaHCO₃, and the study was performed under 225 psi at a temperature of 25 °C.

After initial membrane performance was stabilized, 50 ppm of skim milk (representing organic foulants) and 100 ppm of colloidal silica (representing inorganic foulants) were added into the feed water. After running 24-30 hours with the aforementioned foulants, a clean-in-place (CIP) was performed with all membranes. After the CIP, the membranes were re-tested under standard operating conditions. The results from the study are shown below.

Figure 104.1

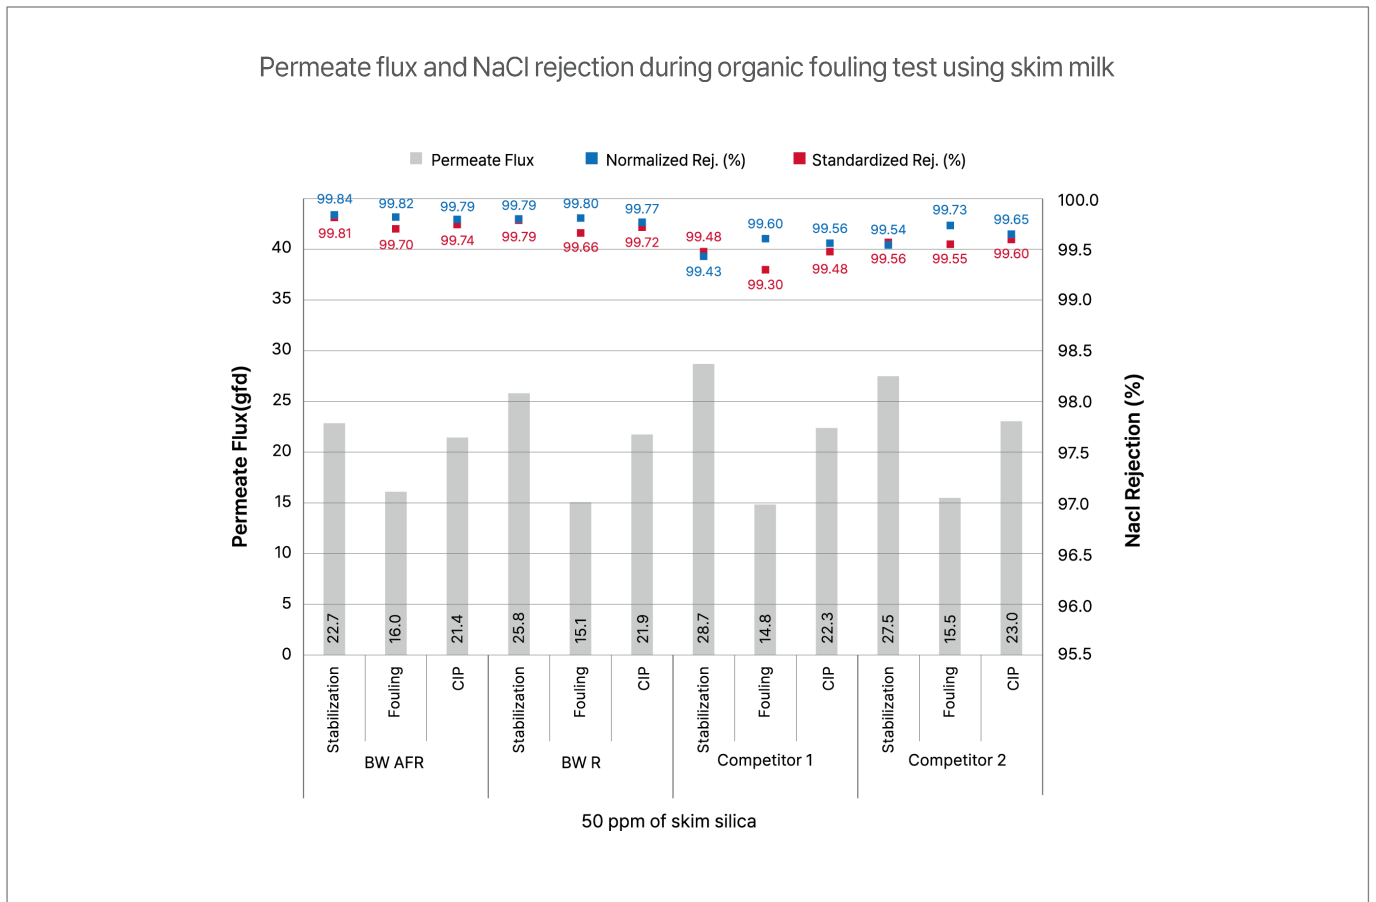

Reverse Osmosis Membrane


Technical Applications Bulletin 104

Fouling Studies on NanoH2O RO Membranes

The results show more consistent salt rejection of BW AFR and BW R membranes during membrane fouling and CIP tests when compared to the competitors. Additionally, when compared to the competitor's membranes after the CIP, NanoH2O RO membranes recovered closer to the initial flux before the fouling test.

In comparing Figure 104.2, the results also show that organic fouling provides more adverse impact to the membrane's performance compared to inorganic fouling. The CIP after organic fouling was not able to recover the membrane flux as well as the CIP after inorganic fouling.

Figure 104.2

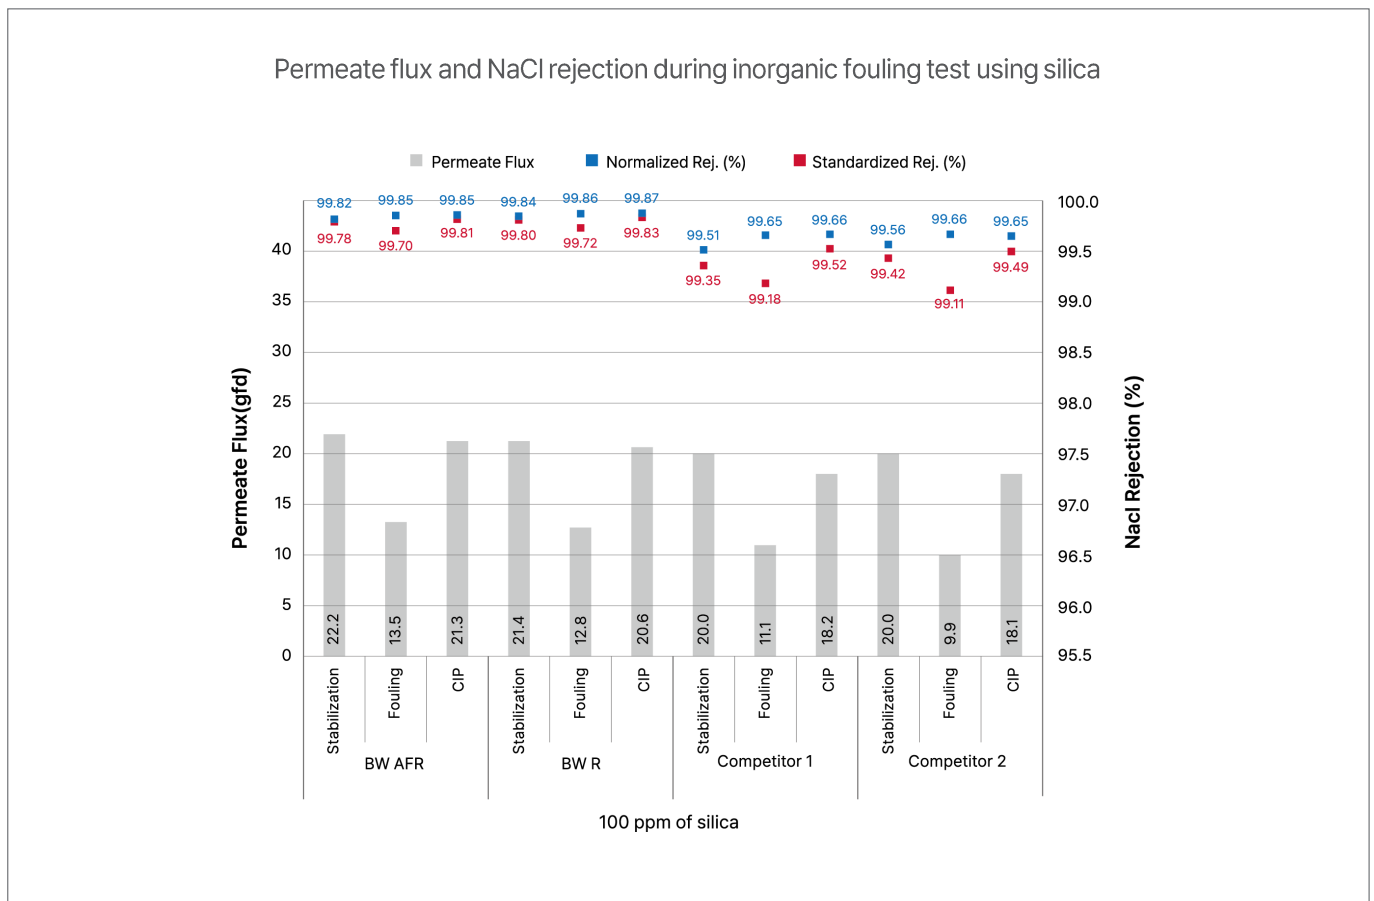

The use of this product in and of itself does not necessarily guarantee the removal of cysts and pathogens from water. Effective cyst and pathogen reduction is dependent on the complete system design and on the operation and maintenance of the system. No freedom from any patent owned NanoH2O CO., Ltd. or others is to be inferred. Because use conditions and applicable laws may differ from one location to another and may change with time. Customer is responsible for determining whether products and the information in this document are appropriate for

Customer's use and for ensuring that Customer's workplace and disposal practices are in compliance with applicable laws and other government enactments. NanoH2O assumes no obligation or liability for the information in this document. NO WARRANTIES ARE GIVEN; ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY EXCLUDED. All trademarks stated herein are properties of their respective companies. © NanoH2O Co., Ltd.,